



REVISIONS				
S/N	DESCRIPTION	PREPARED BY	DATE	APPROVED

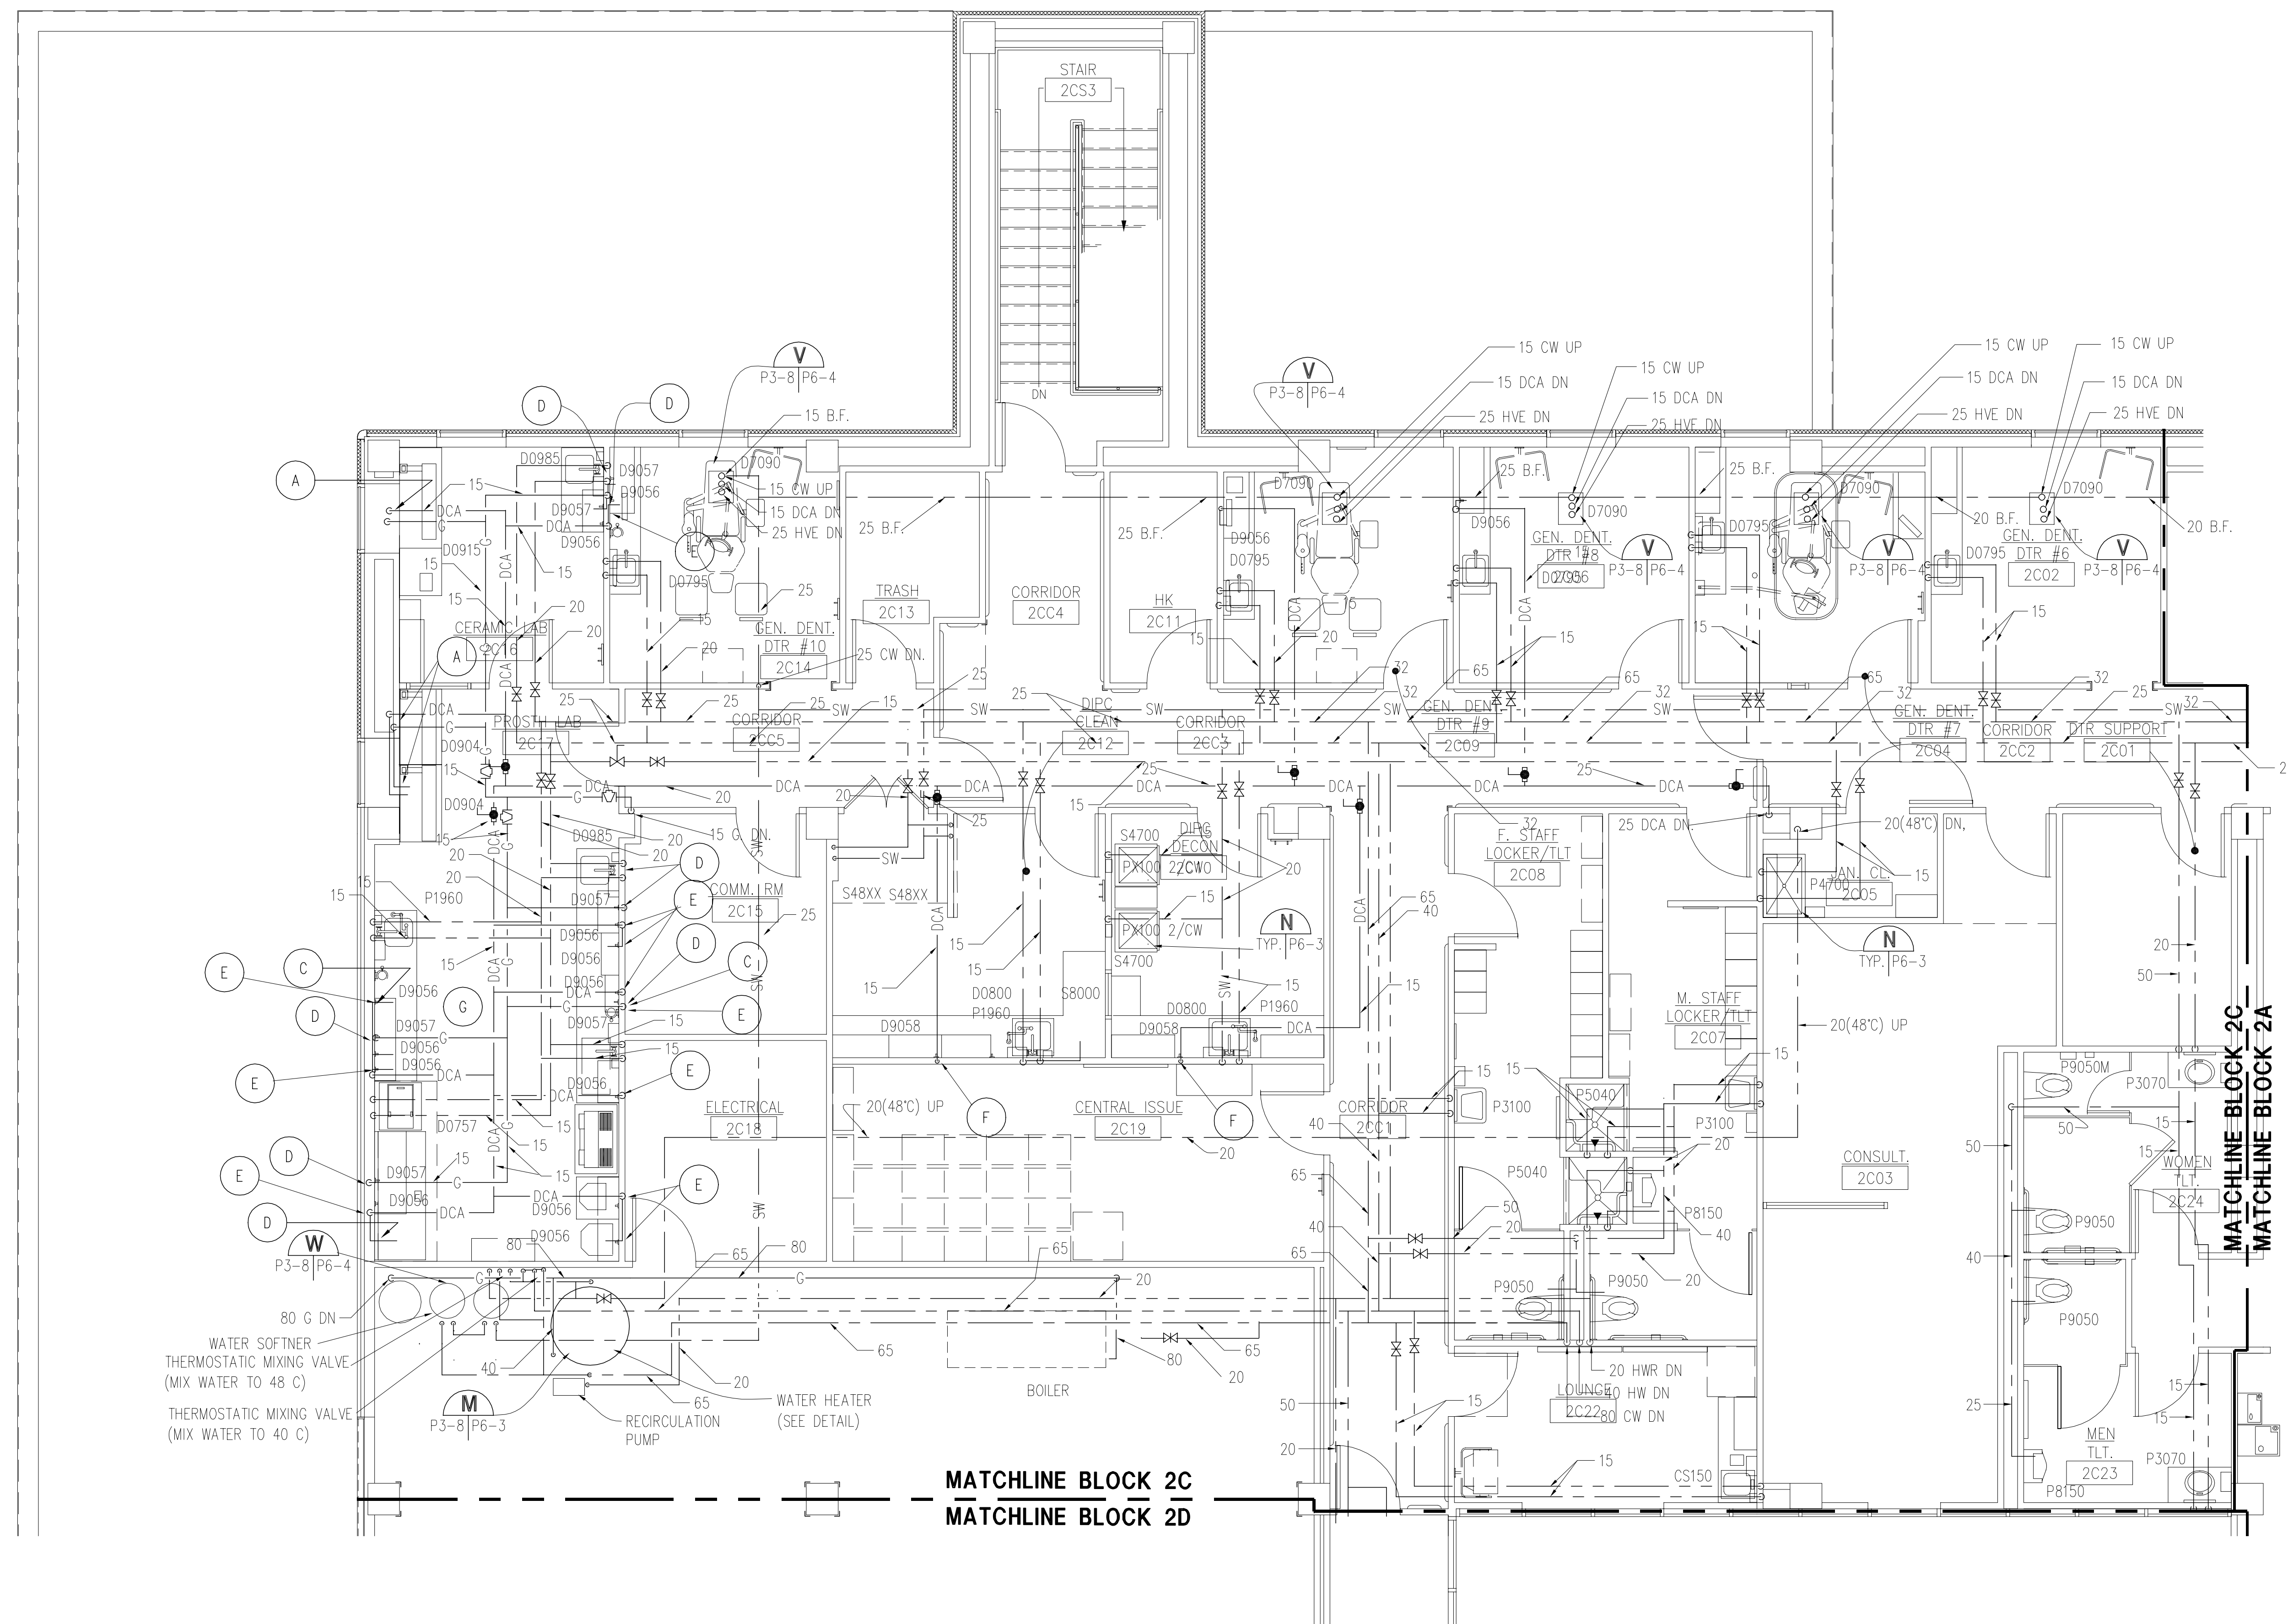


NOTES:

- (A) TWO 15mm AIR STUB OUTS WITH SCREW ON CAPS FOR EASY ACCESS AND DIRECT CONNECTION TO D9094 AND D9095 WORK STATIONS.
- (B) PROVIDE A 10mm QUICK AIR DISCONNECT AND A GAS NEEDLE VALVE AT BOTH 457mm AND 1016mm ABOVE FLOOR, (FOR CASTING BENCH D9030M) SEE DETAIL SHEET PG-3
- (C) PROVIDE HARD CONNECTION 610mm FROM FLOOR FOR DCA90.
- (D) SEE NEEDLE VALVE D9057 AT 1100mm A.F.F. SEE GAS NEEDLE VALVE DETAIL ON SH. PG-3
- (E) 10mm QUICK AIR DISCONNECT D9056 TO BE LOCATED AT 1100mm A.F.F. SEE DISCONNECT DETAIL ON SH. PG-3
- (F) 6mm QUICK AIR CONNECT D9058 LOCATED 1100mm A.F.F. SEE DETAIL SH. PG-1
- (G) 15mm WATER STUBOUT AT 686 A.F.F. FOR MODEL TRIMMER.

NOTE THAT PIPES ARE RUN ABOVE THE CEILING  
OF THE FLOOR ON WHICH IT IS SHOWN.

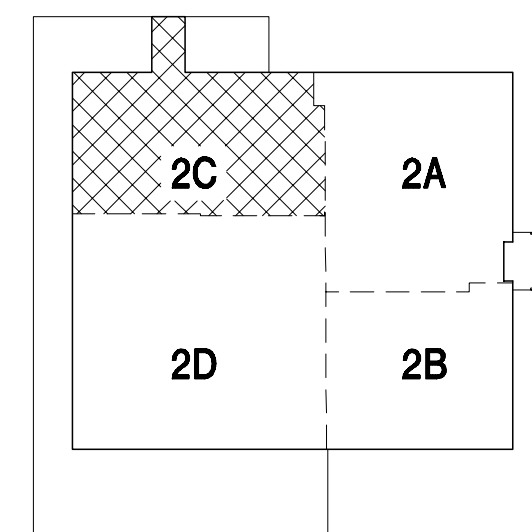

**2ND FLOOR**  
**BLOCK 2C**  
**KEY PLAN**

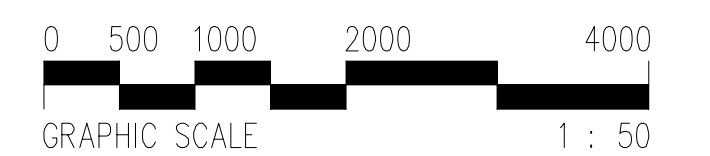

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

3-8

## MEDICAL/DENTAL CLINIC [REDACTED]

WATER & MEDICAL GAS PIPING  
SECOND FLOOR PLAN - BLOCK 2C

SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXXX	8144706	
		CONST. CONTR. NO.	
SCALE:	AS SHOWN	SPEC. 11996048	SHEET 201 OF 316