



NOTE:
TWO (2) REQUIRED AT EACH PUMP.

FLOOR MOUNTED PUMP SUPPORT DETAIL 29
NO SCALE M7-4 M7-6

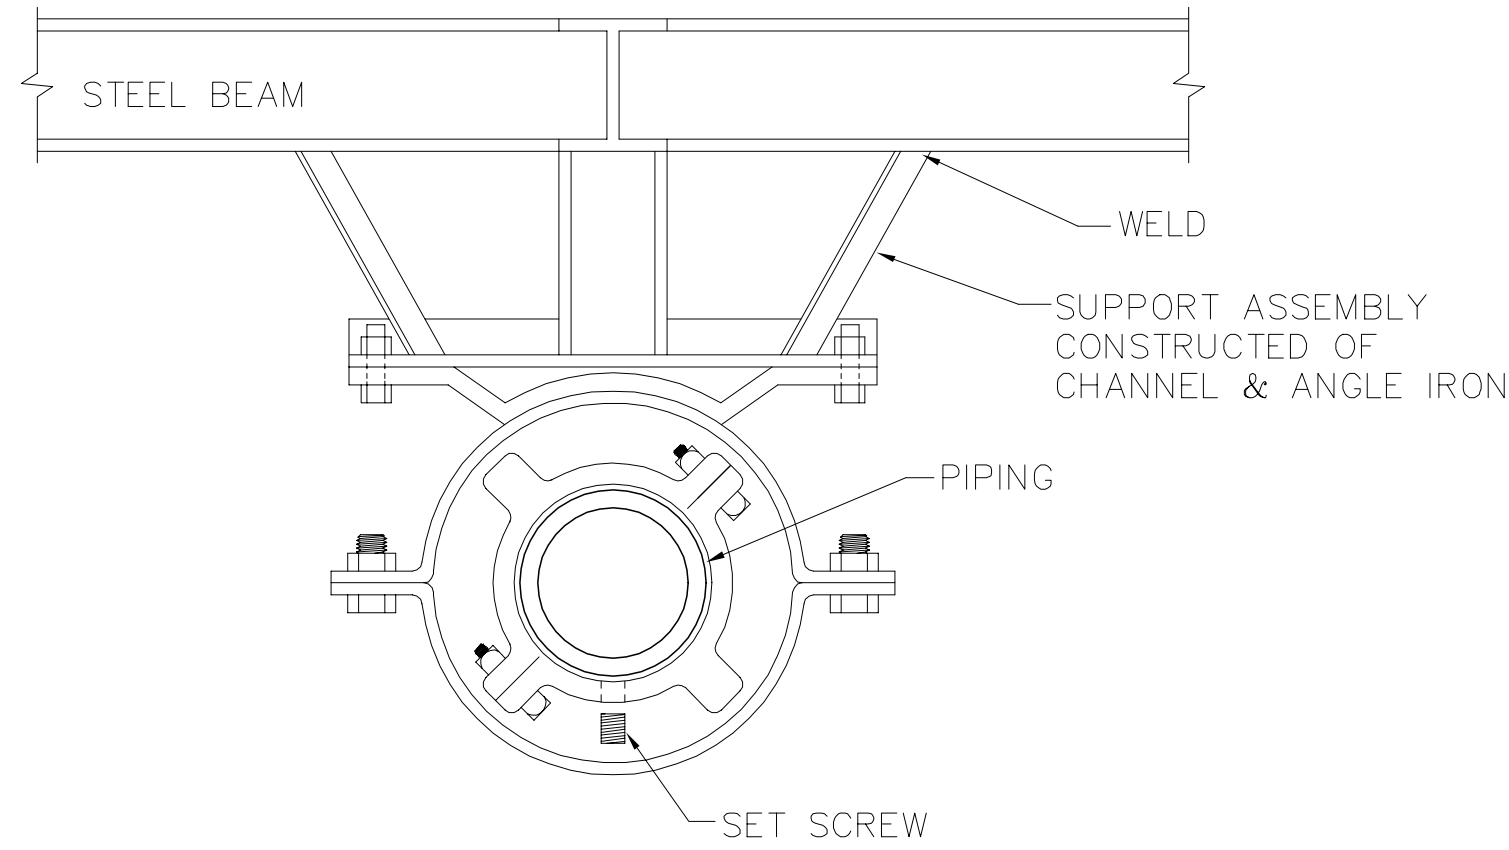

PIPE ALIGNMENT GUIDE 30
NOT TO SCALE M7-6 M7-6

NOTE:
PIPE ANCHOR SHALL BE SIMILAR TO THAT INDICATED ABOVE EXCEPT THAT PIPE GUIDE AND PIPING SHALL BE WELDED TO THE RETAINING RING SO THAT PIPE IS STATIONARY.

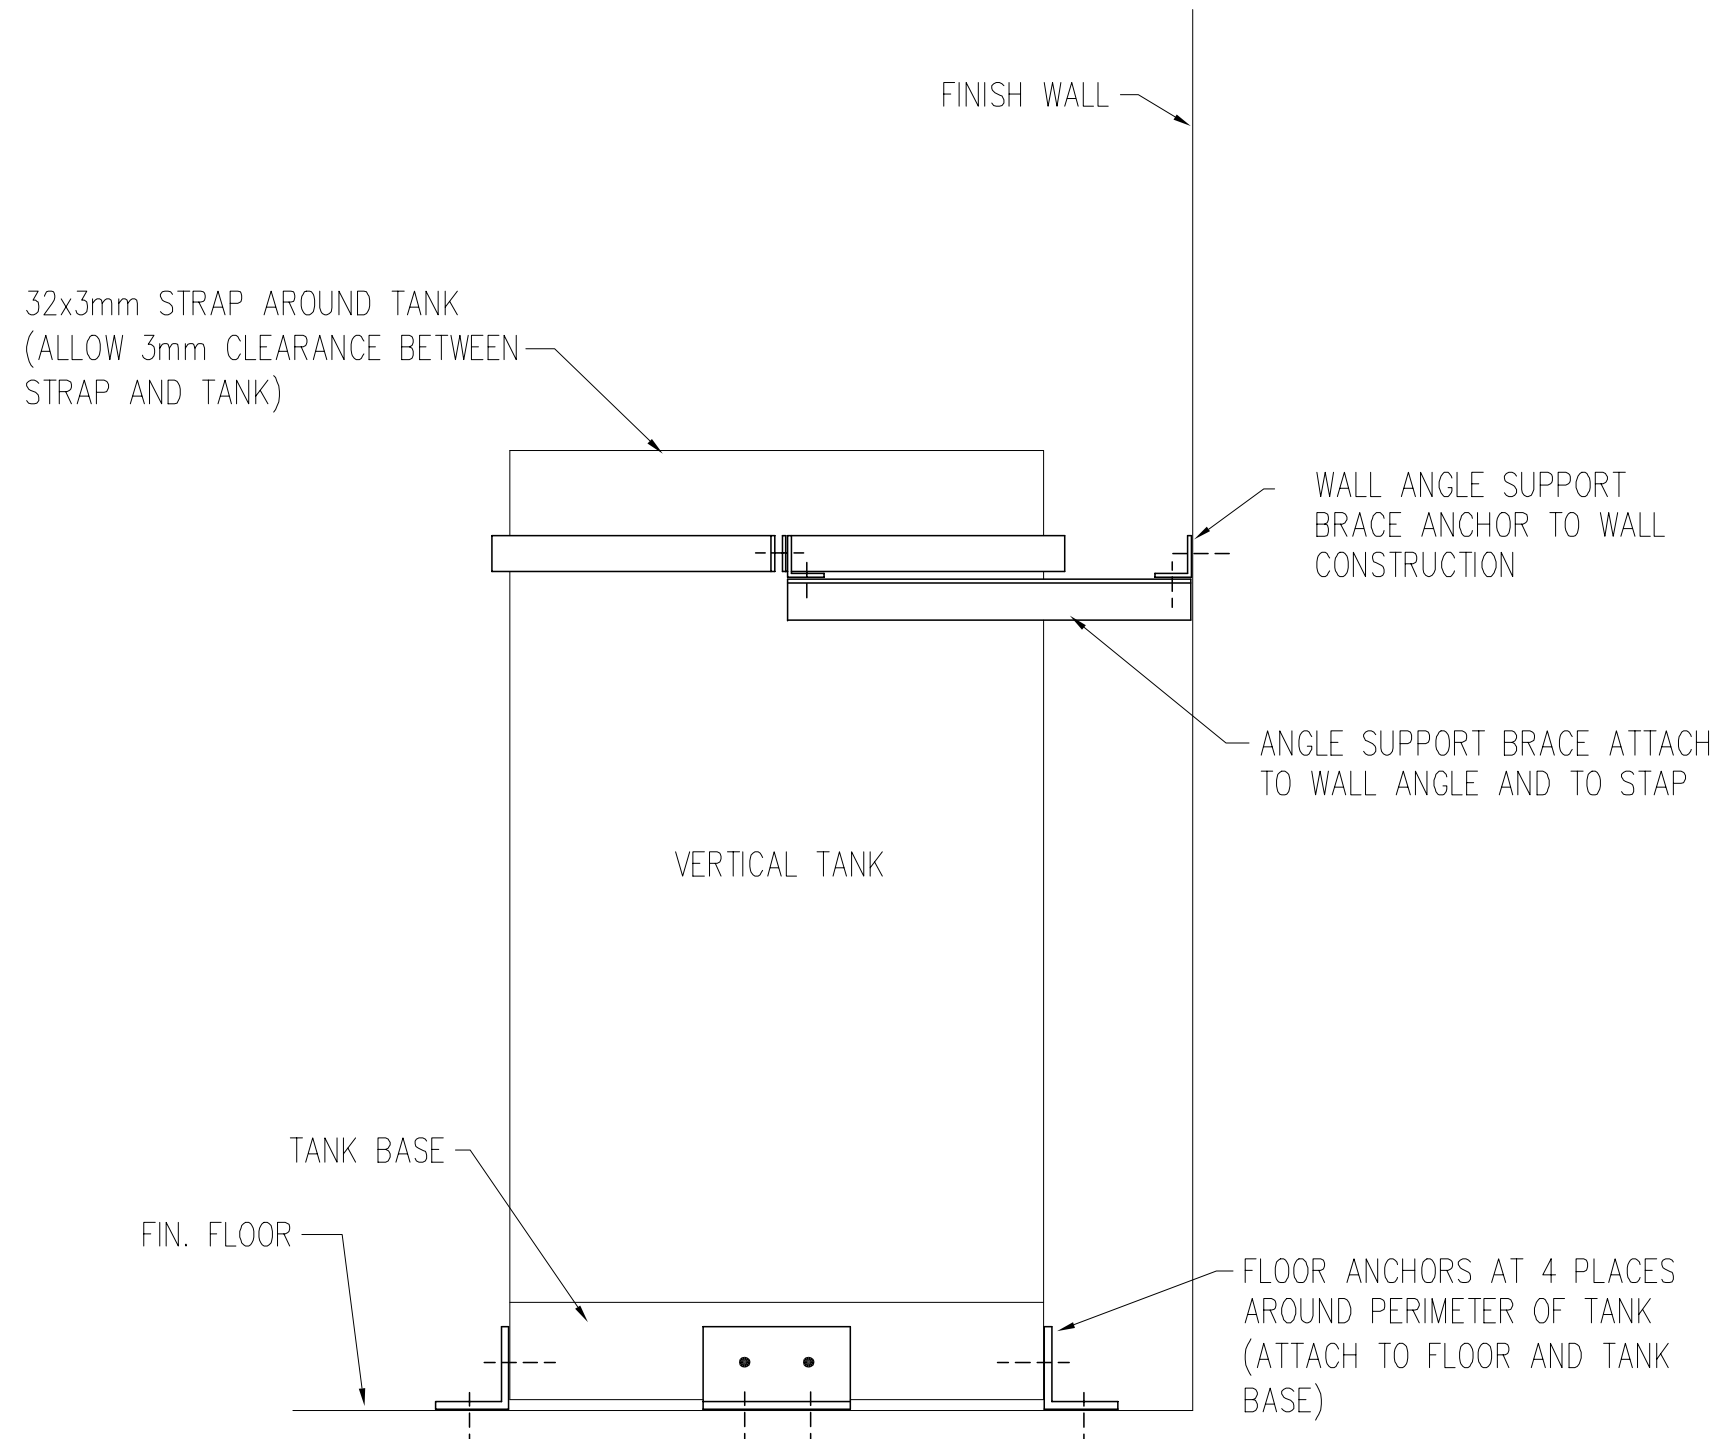

VERTICAL FLOOR MOUNTED TANK SUPPORT DETAIL 31
NO SCALE TYP. M7-6

NOTE:
TYPICAL FOR ALL VERTICAL TANKS SUCH AS WATER HEATERS, EXPANSION TANKS, RECEIVERS, WATER SOFTENER TANKS, ETC .

ISOLATOR LEGEND AND DESCRIPTION

MARK	DESCRIPTION
I	EQUIPMENT FRAME WITH CONCRETE INERTIA BASE WITH SEISMIC RESTRAINED SPRING ISOLATORS MOUNTED ON FLOOR. SPRING ISOLATORS SHALL BE ANCHORED TO FLOOR AND EQUIPMENT FRAME. EQUIPMENT SHALL BE ANCHORED TO BASE.
SX	FLOOR MOUNTED SPRING ISOLATORS, ALL DIRECTIONAL TYPE WITH SEISMIC CONTROL.
PN	NEOPRENE FLOOR PAD ISOLATOR.
HS	SUSPENDED TYPE SPRING ISOLATION HANGER.
HN	SUSPENDED TYPE NEOPRENE ISOLATION HANGER.
MN	NEOPRENE FLOOR MOUNTING

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

M7-6

MEDICAL/DENTAL CLINIC

HVAC
DETAILS

SIZE	CODE IDENT. NO.	DRAWING NO.
F	XXXXX	8144748
	CONST. CONTR. NO.	
SCALE:	AS SHOWN	SPEC. 11996048 SHEET 243 OF 316