
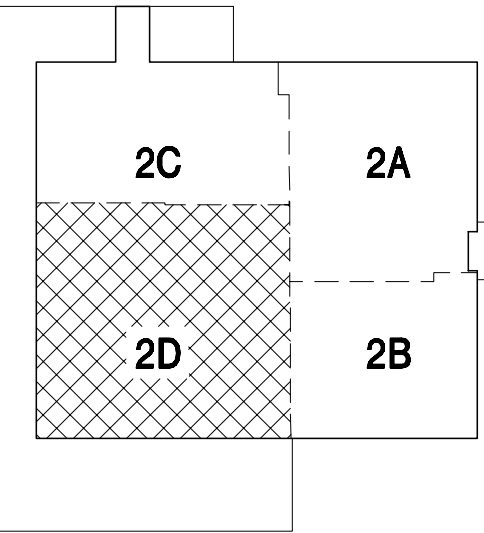


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED


NOTES:

- SHUNT TRIP PUSH BUTTON TO SHUT DOWN BOILER. PROVIDE 2 #12 & 1 #12(GND)-3/4" C. TO SHUNT TRIP CIRCUIT BREAKER IN PANEL N22C, CIRCUIT #35. PROVIDE SIGNAGE ABOVE PUSH BUTTON TO READ "EMERGENCY BOILER SHUT DOWN".
- SEE SINGLE LINE DIAGRAM FOR AHU-1 AND AHU-2 ELECTRICAL DATA.

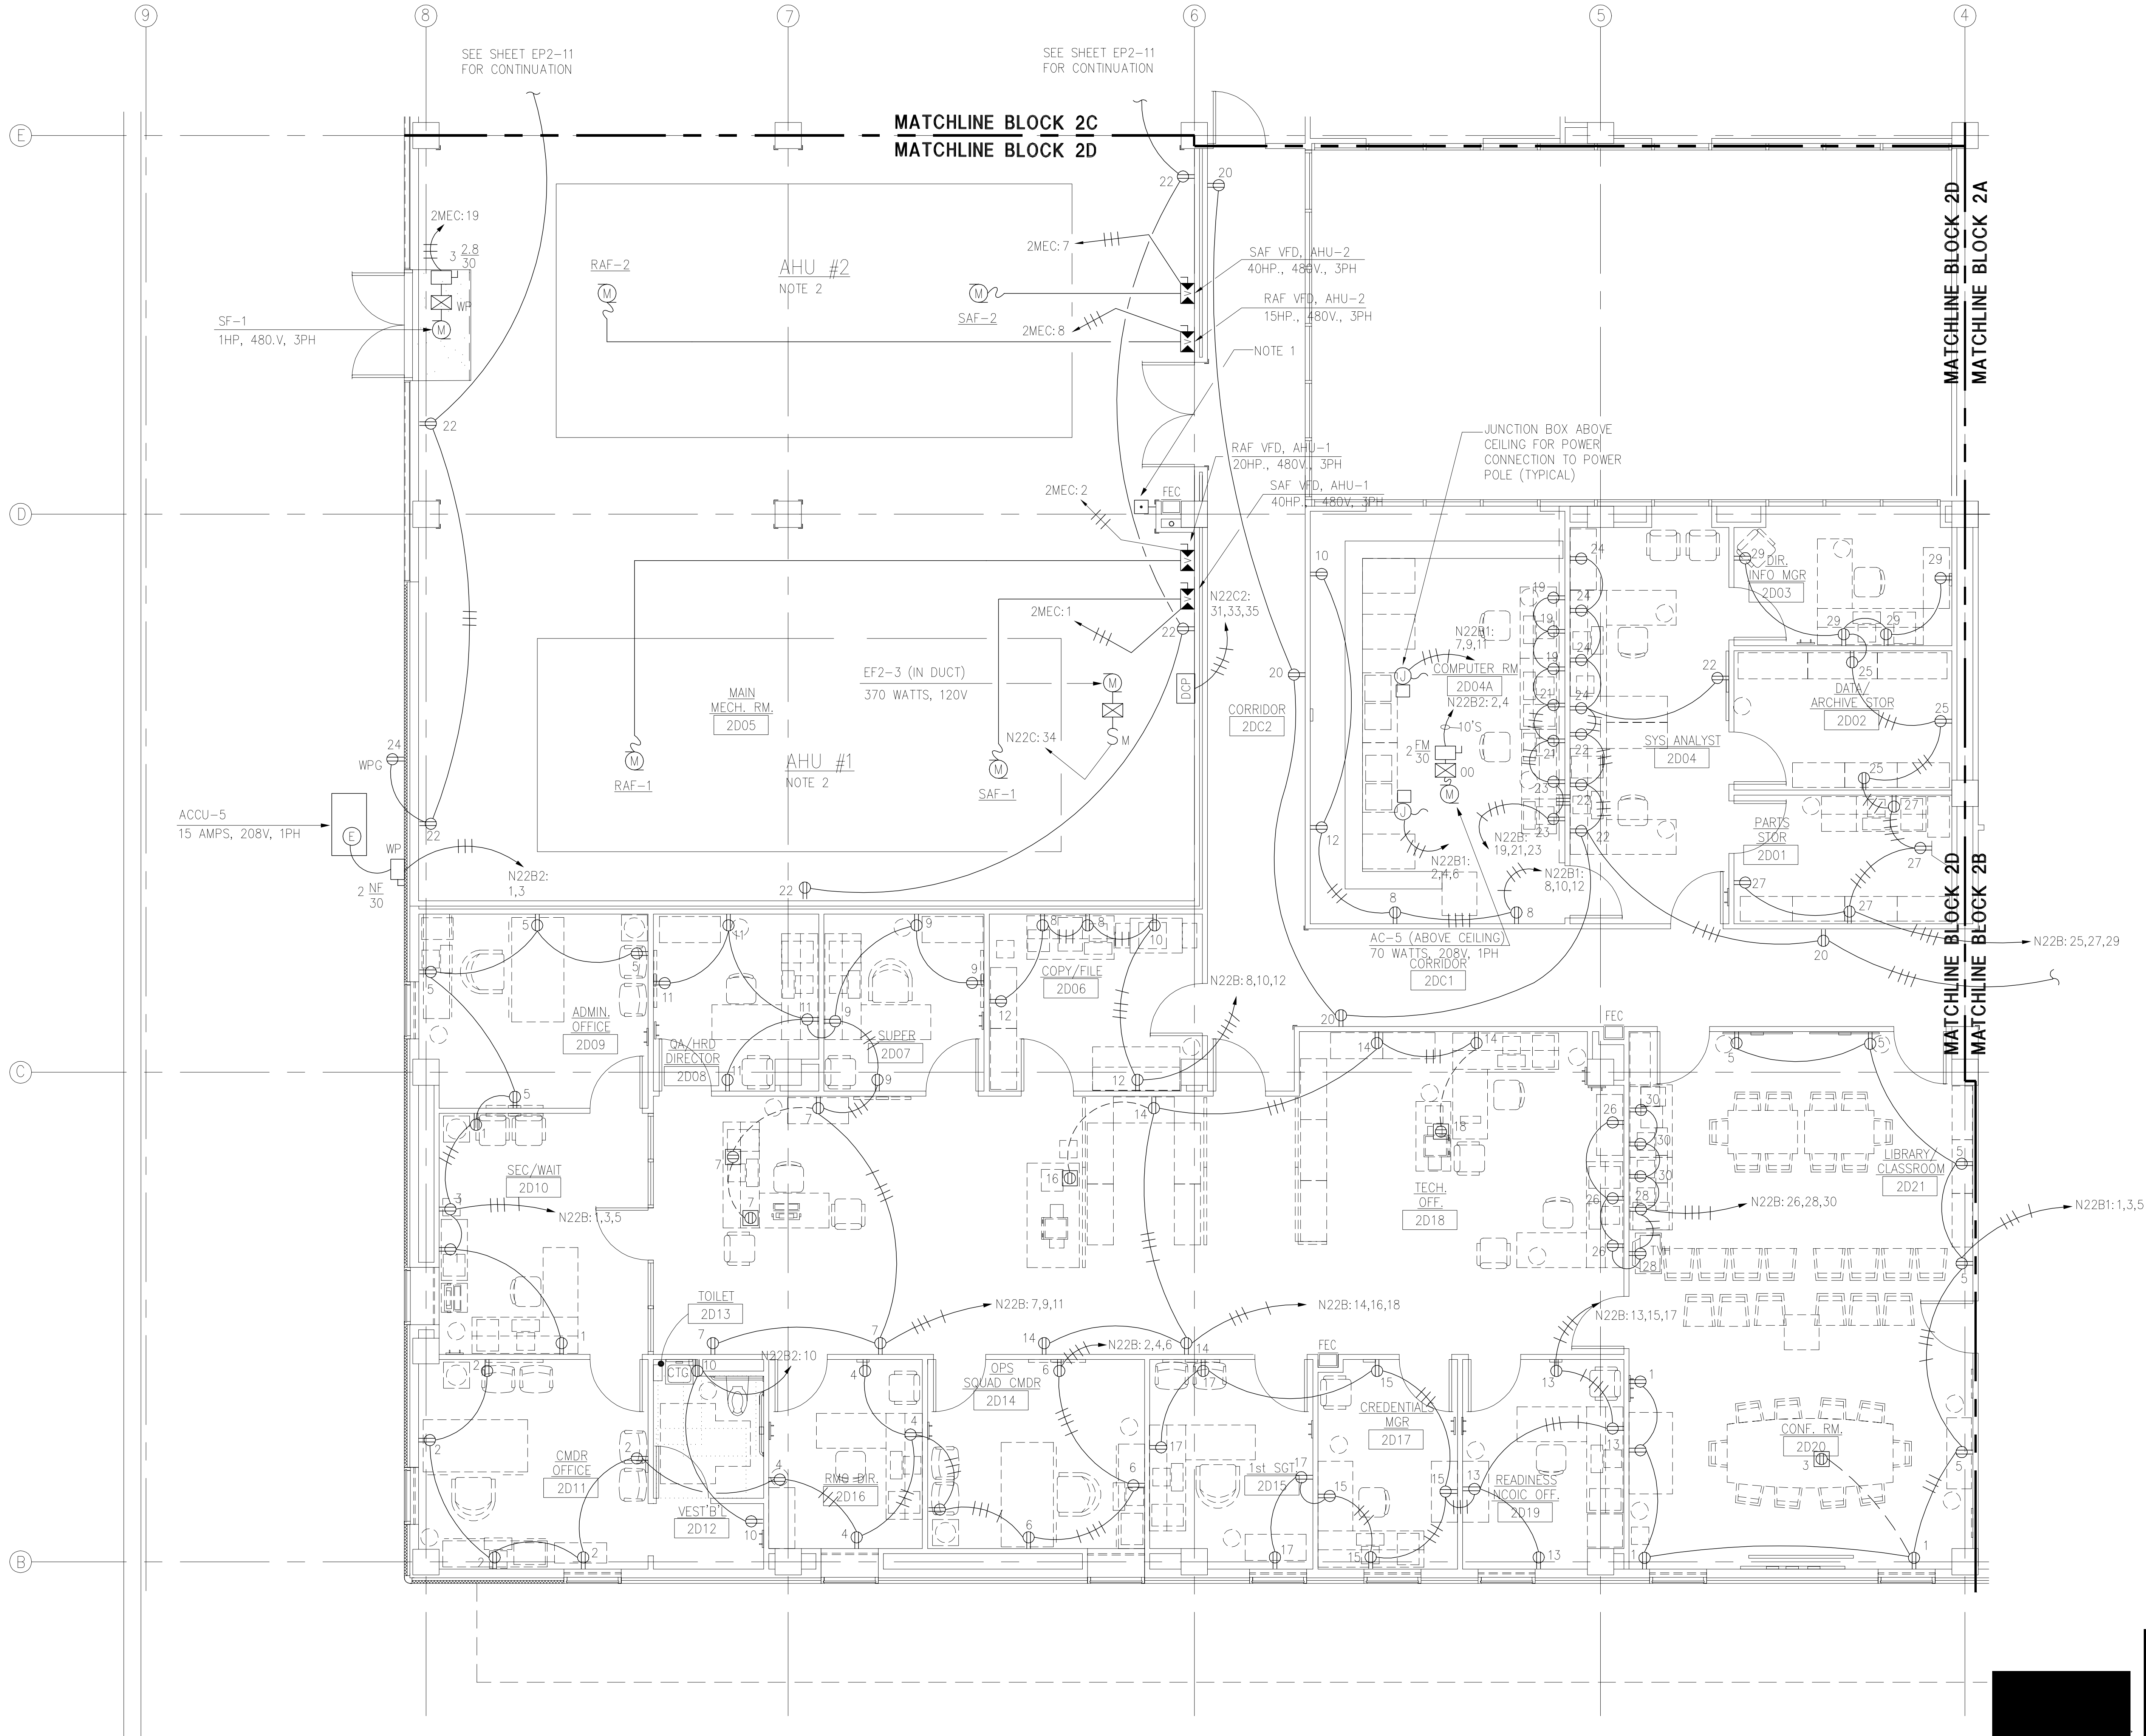

2ND FLOOR
BLOCK 2D
KEY PLAN

POWER
SECOND FLOOR PLAN
BLOCK 2D
SCALE: 1:50

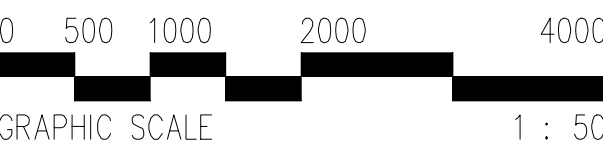

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

EP2-12

MEDICAL/DENTAL CLINIC			
POWER - SECOND FLOOR PLAN - BLOCK 2D			
SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXX	8144789	
SCALE:	AS SHOWN	SPEC.	11996048
			SHEET 284 OF 316