


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

DRIVE-UP INTERCOM SYSTEM NOTES:

1. MOUNTING HEIGHTS OF DRIVE-UP INTERCOM SYSTEM DEVICES ABOVE FINISHED FLOOR SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED. (MOUNTING HEIGHTS ARE TO CENTERLINE OF DEVICE, EXCEPT WHERE NOTED).

BASE STATION.....1525mm TO BOTTOM  
INTERCONNECT MODULE.....609mm  
LOOP DETECTOR CONTROL.....609mm

2. SYSTEM DESIGN SHOWN IS BASED ON 3M C906 SERIES INTERCOM SYSTEM. ADJUST EQUIPMENT INTERCONNECT AS REQUIRED FOR OTHER MANUFACTURERS.

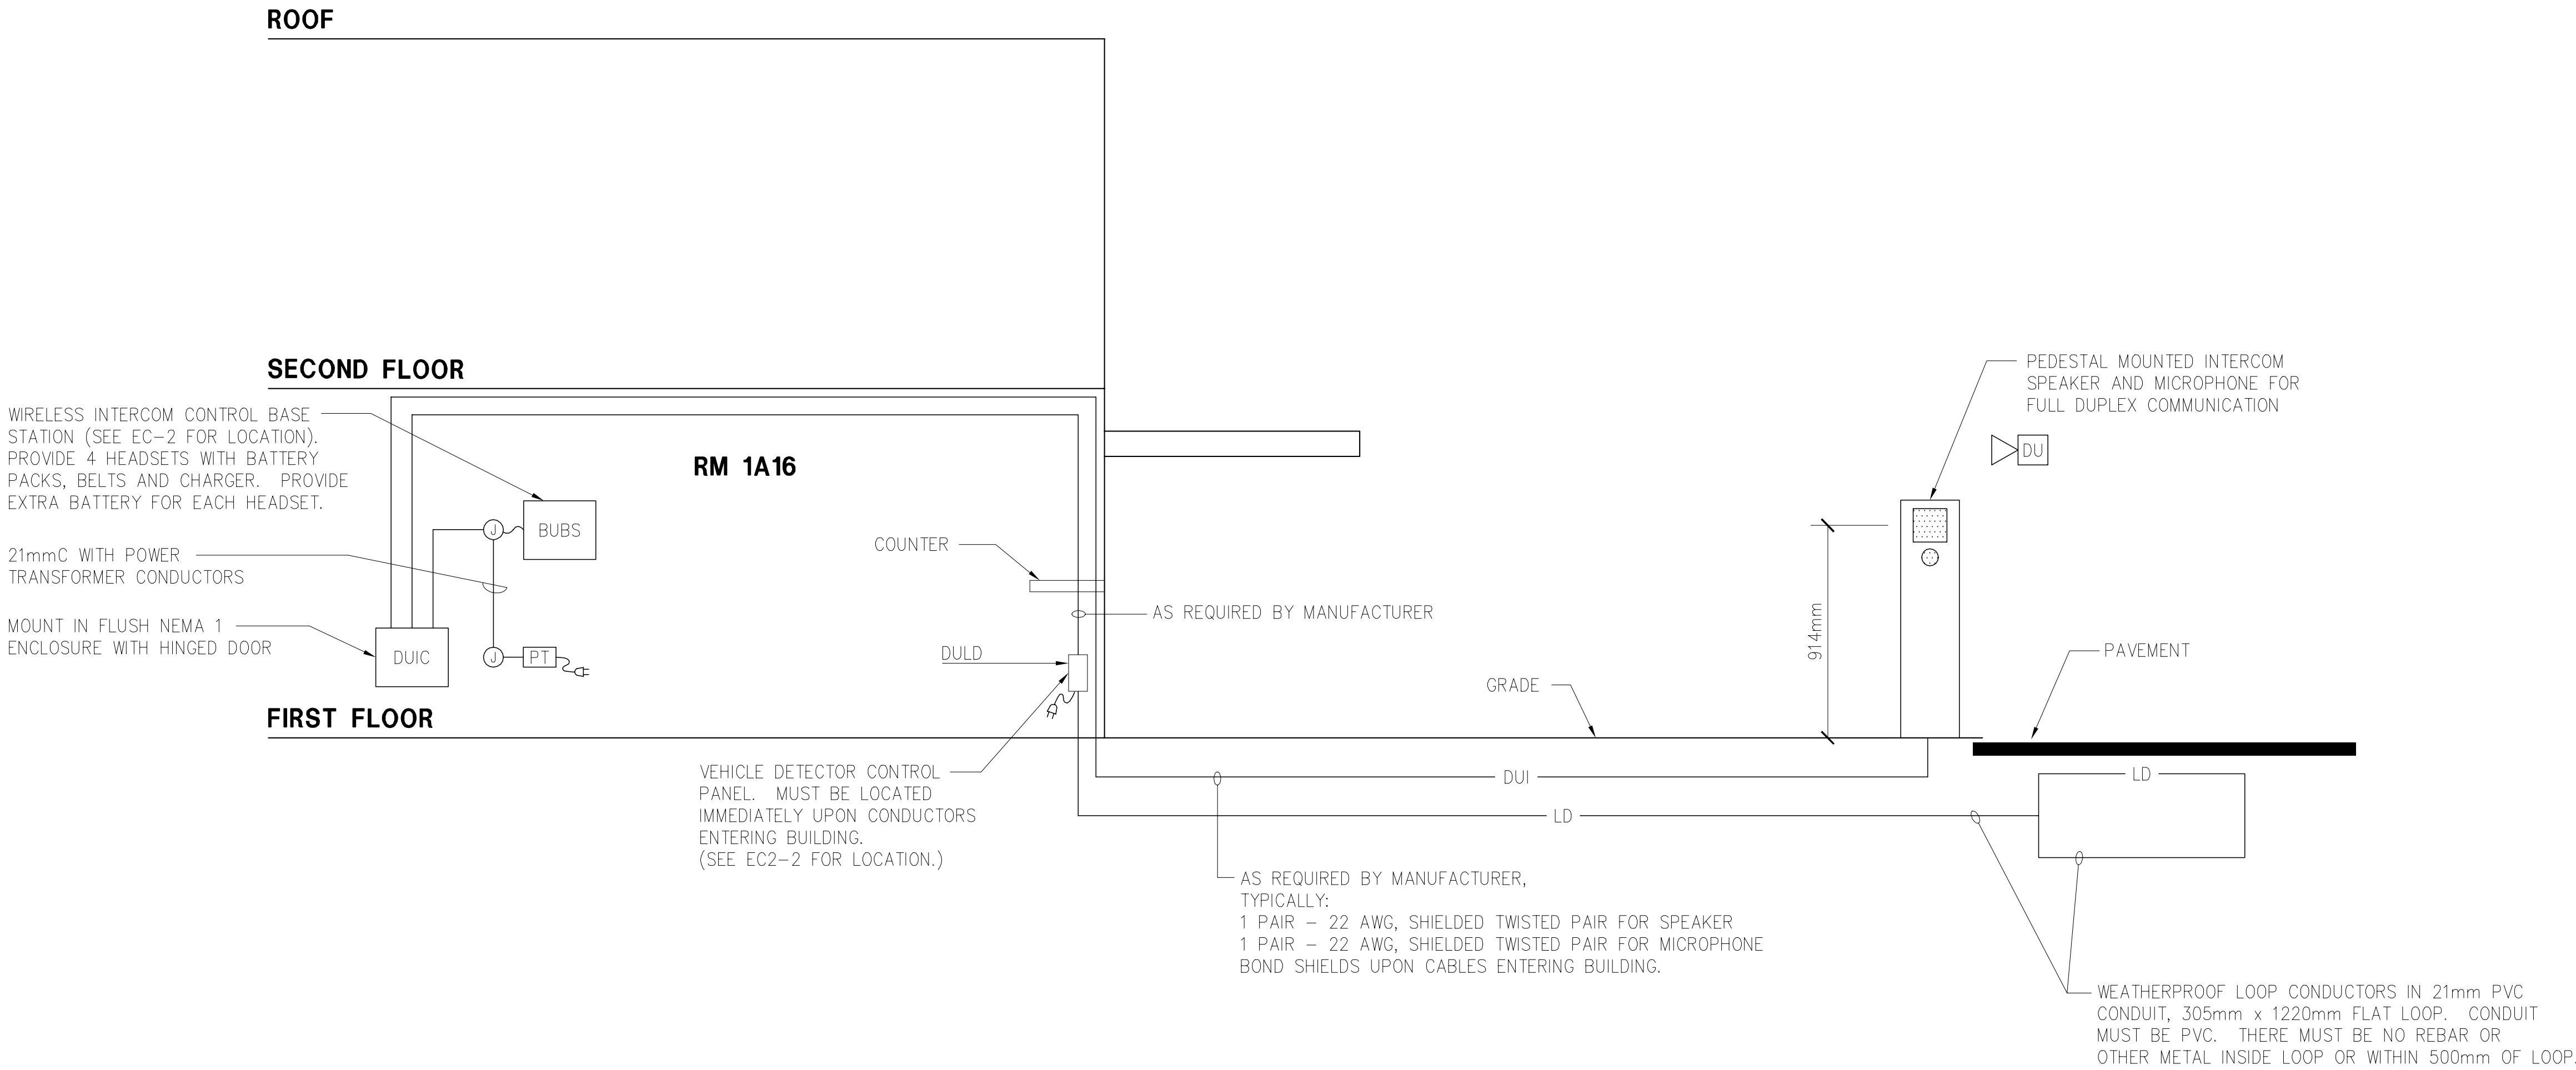

PHARMACY DRIVE-UP WINDOW INTERCOM SYSTEM - SINGLE LINE DIAGRAM  
NO SCALE

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

EC11-1

MEDICAL/DENTAL CLINIC			
PHARMACY DRIVE-UP WINDOW INTERCOM SYSTEM - SINGLE LINE DIAGRAM			
SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXX	8144821	
CONST. CONTR. NO.			
SCALE: AS SHOWN		SPEC. 11996048	SHEET 316 OF 316