


REVISIONS				
SYM	DESCRIPTION	PREPARED BY	DATE	APPROVED

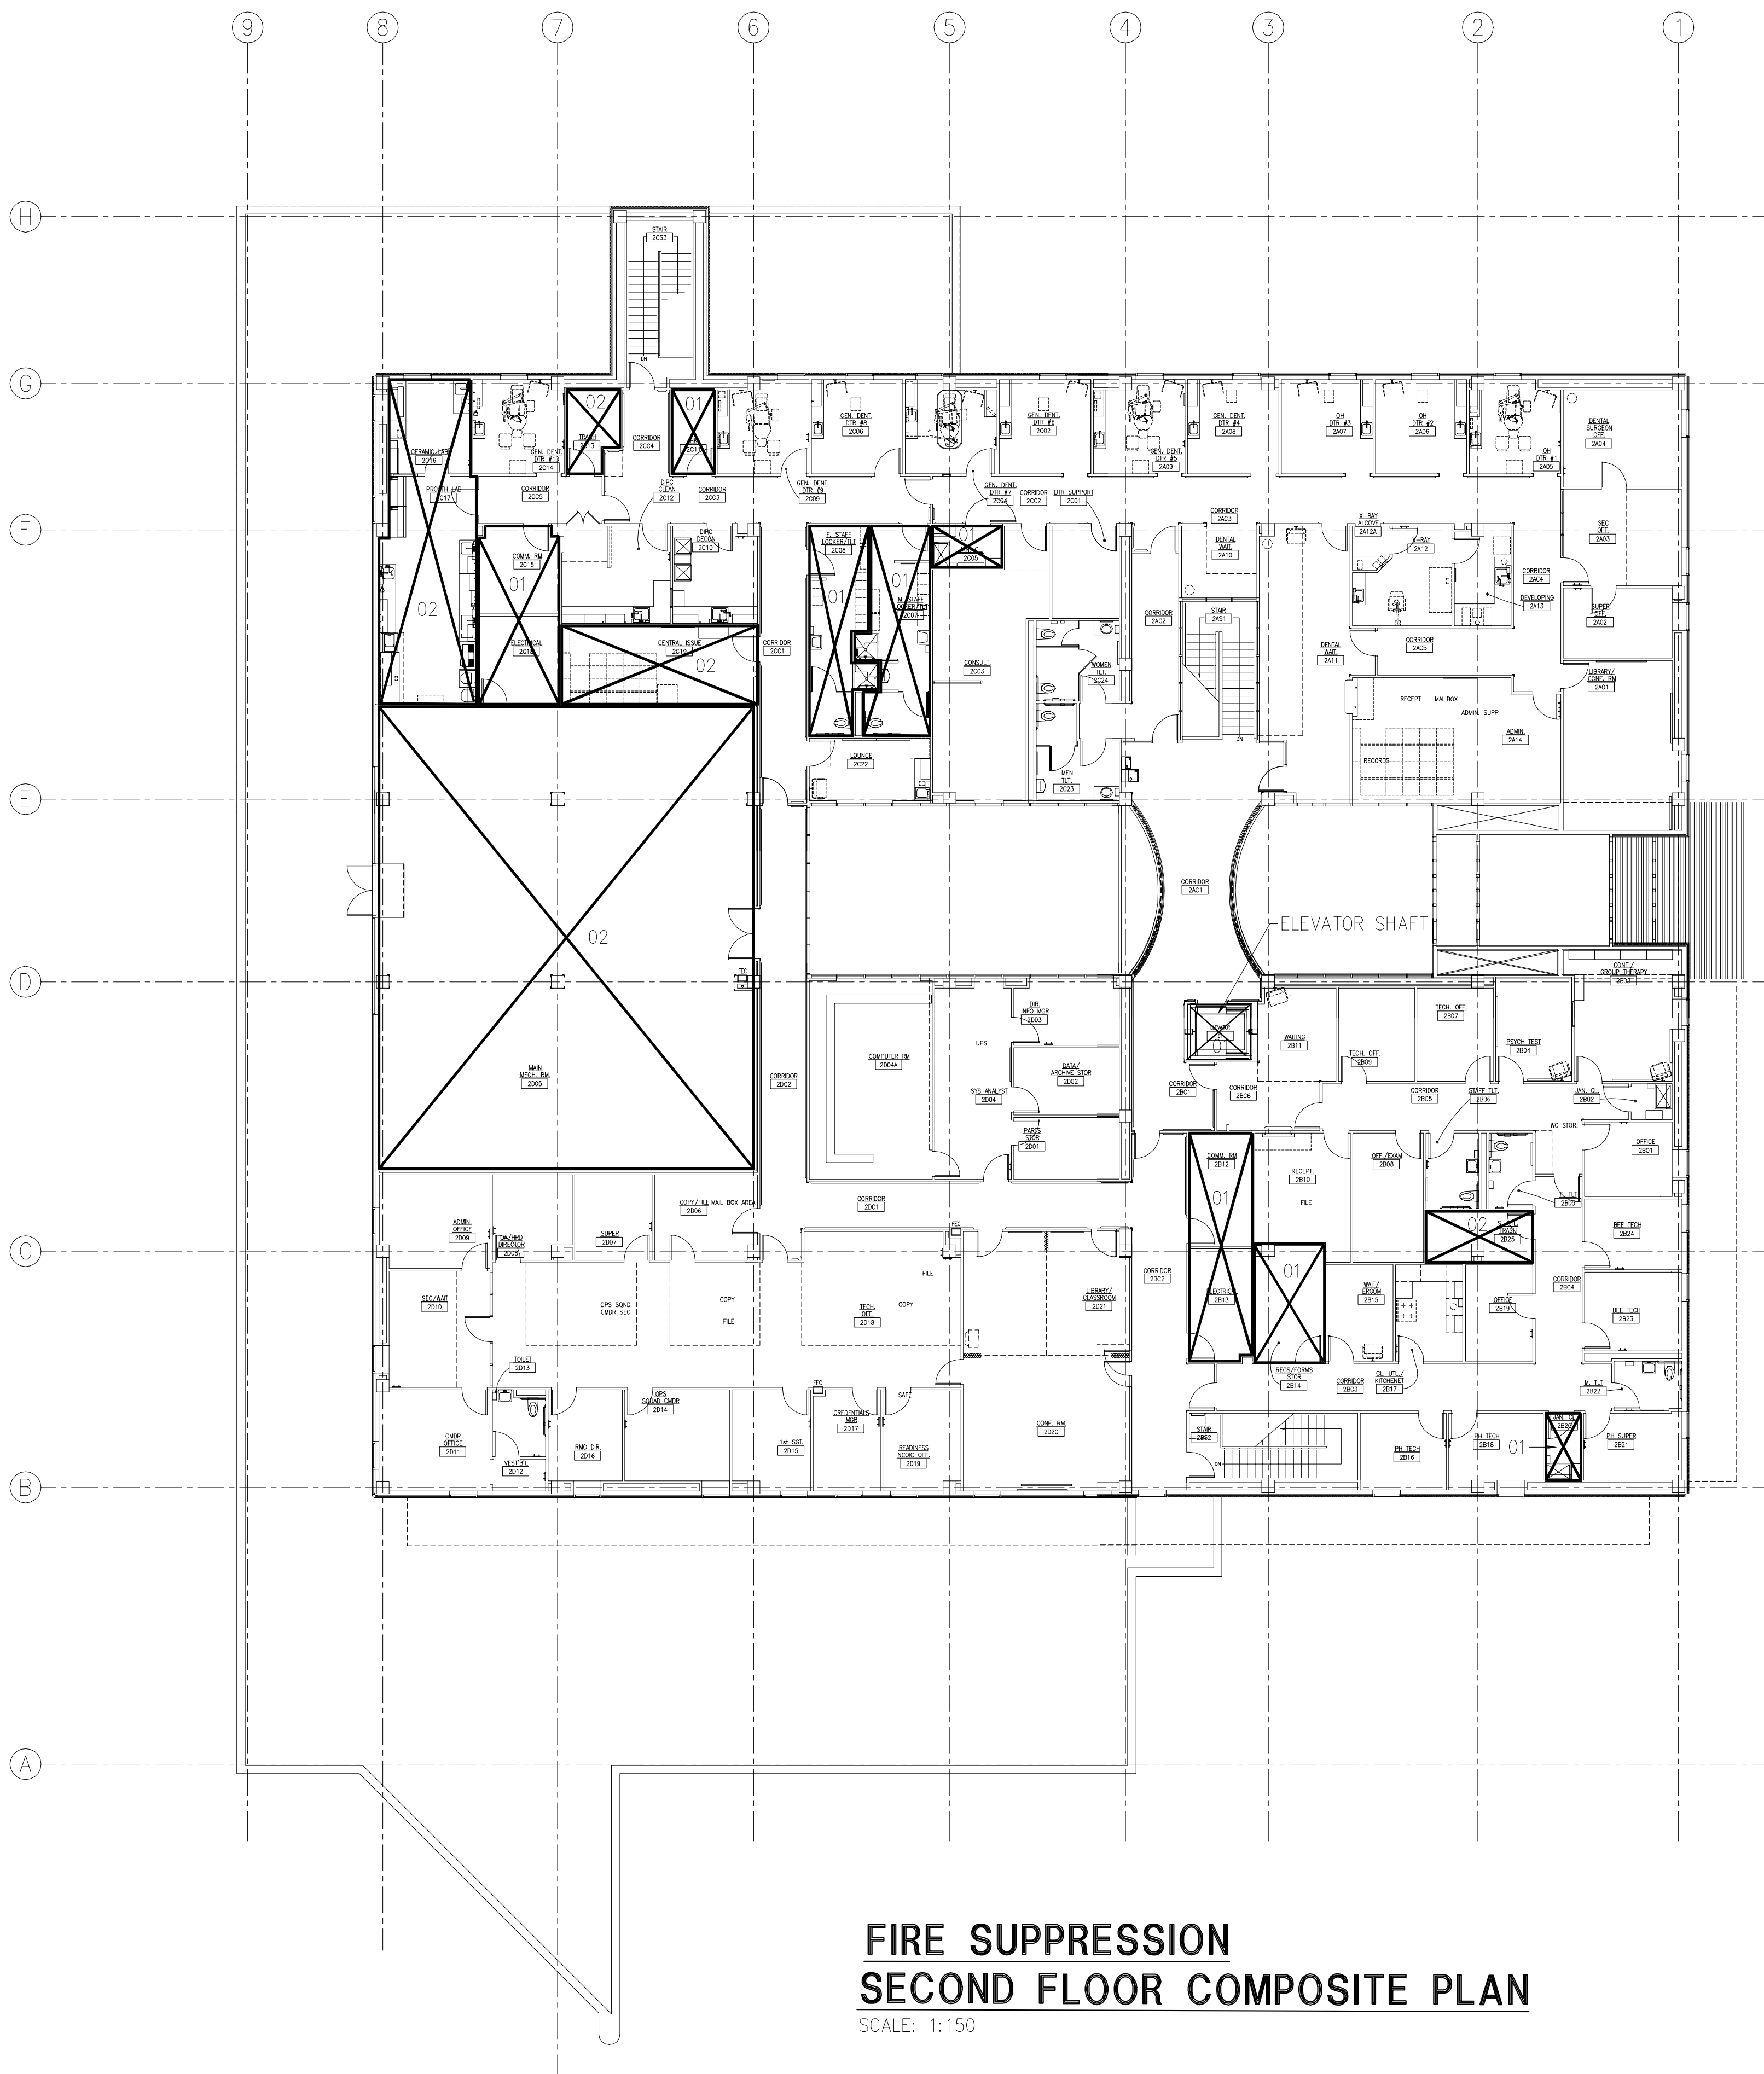


LEGEND


LIGHT HAZARD = ALL AREAS NOT MARKED
ORDINARY HAZARD GROUP 1 = 01
ORDINARY HAZARD GROUP 2 = 02

NOTE:

SEE SHEET P9-3 FOR BASIS OF DESIGN, NOTES, AND
DETAILS FOR INSTALLATION OF THE WET PIPE SPRINKLER
SYSTEM.

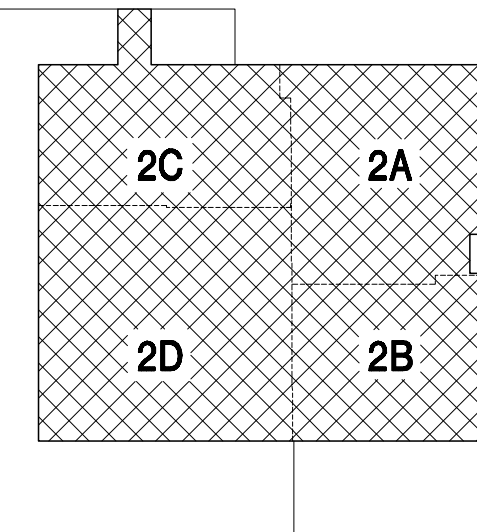

COMPOSITE
2ND FLOOR
KEY PLAN

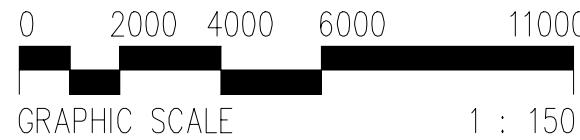

FIRE SUPPRESSION
SECOND FLOOR COMPOSITE PLAN

SCALE: 1:150

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

P9-2

MEDICAL/DENTAL CLINIC			
FIRE SUPPRESSION SECOND FLOOR COMPOSITE PLAN			
SIZE	CODE IDENT. NO.	DRAWING NO.	
F	XXXXX	8144715	
CONST. CONTR. NO.		11996048	
SCALE:	AS SHOWN	SPEC.	11996048
		SHEET 210 OF 316	