




| REVISIONS |             |             |      |          |
|-----------|-------------|-------------|------|----------|
| SYM       | DESCRIPTION | PREPARED BY | DATE | APPROVED |
|           |             |             |      |          |
|           |             |             |      |          |
|           |             |             |      |          |
|           |             |             |      |          |

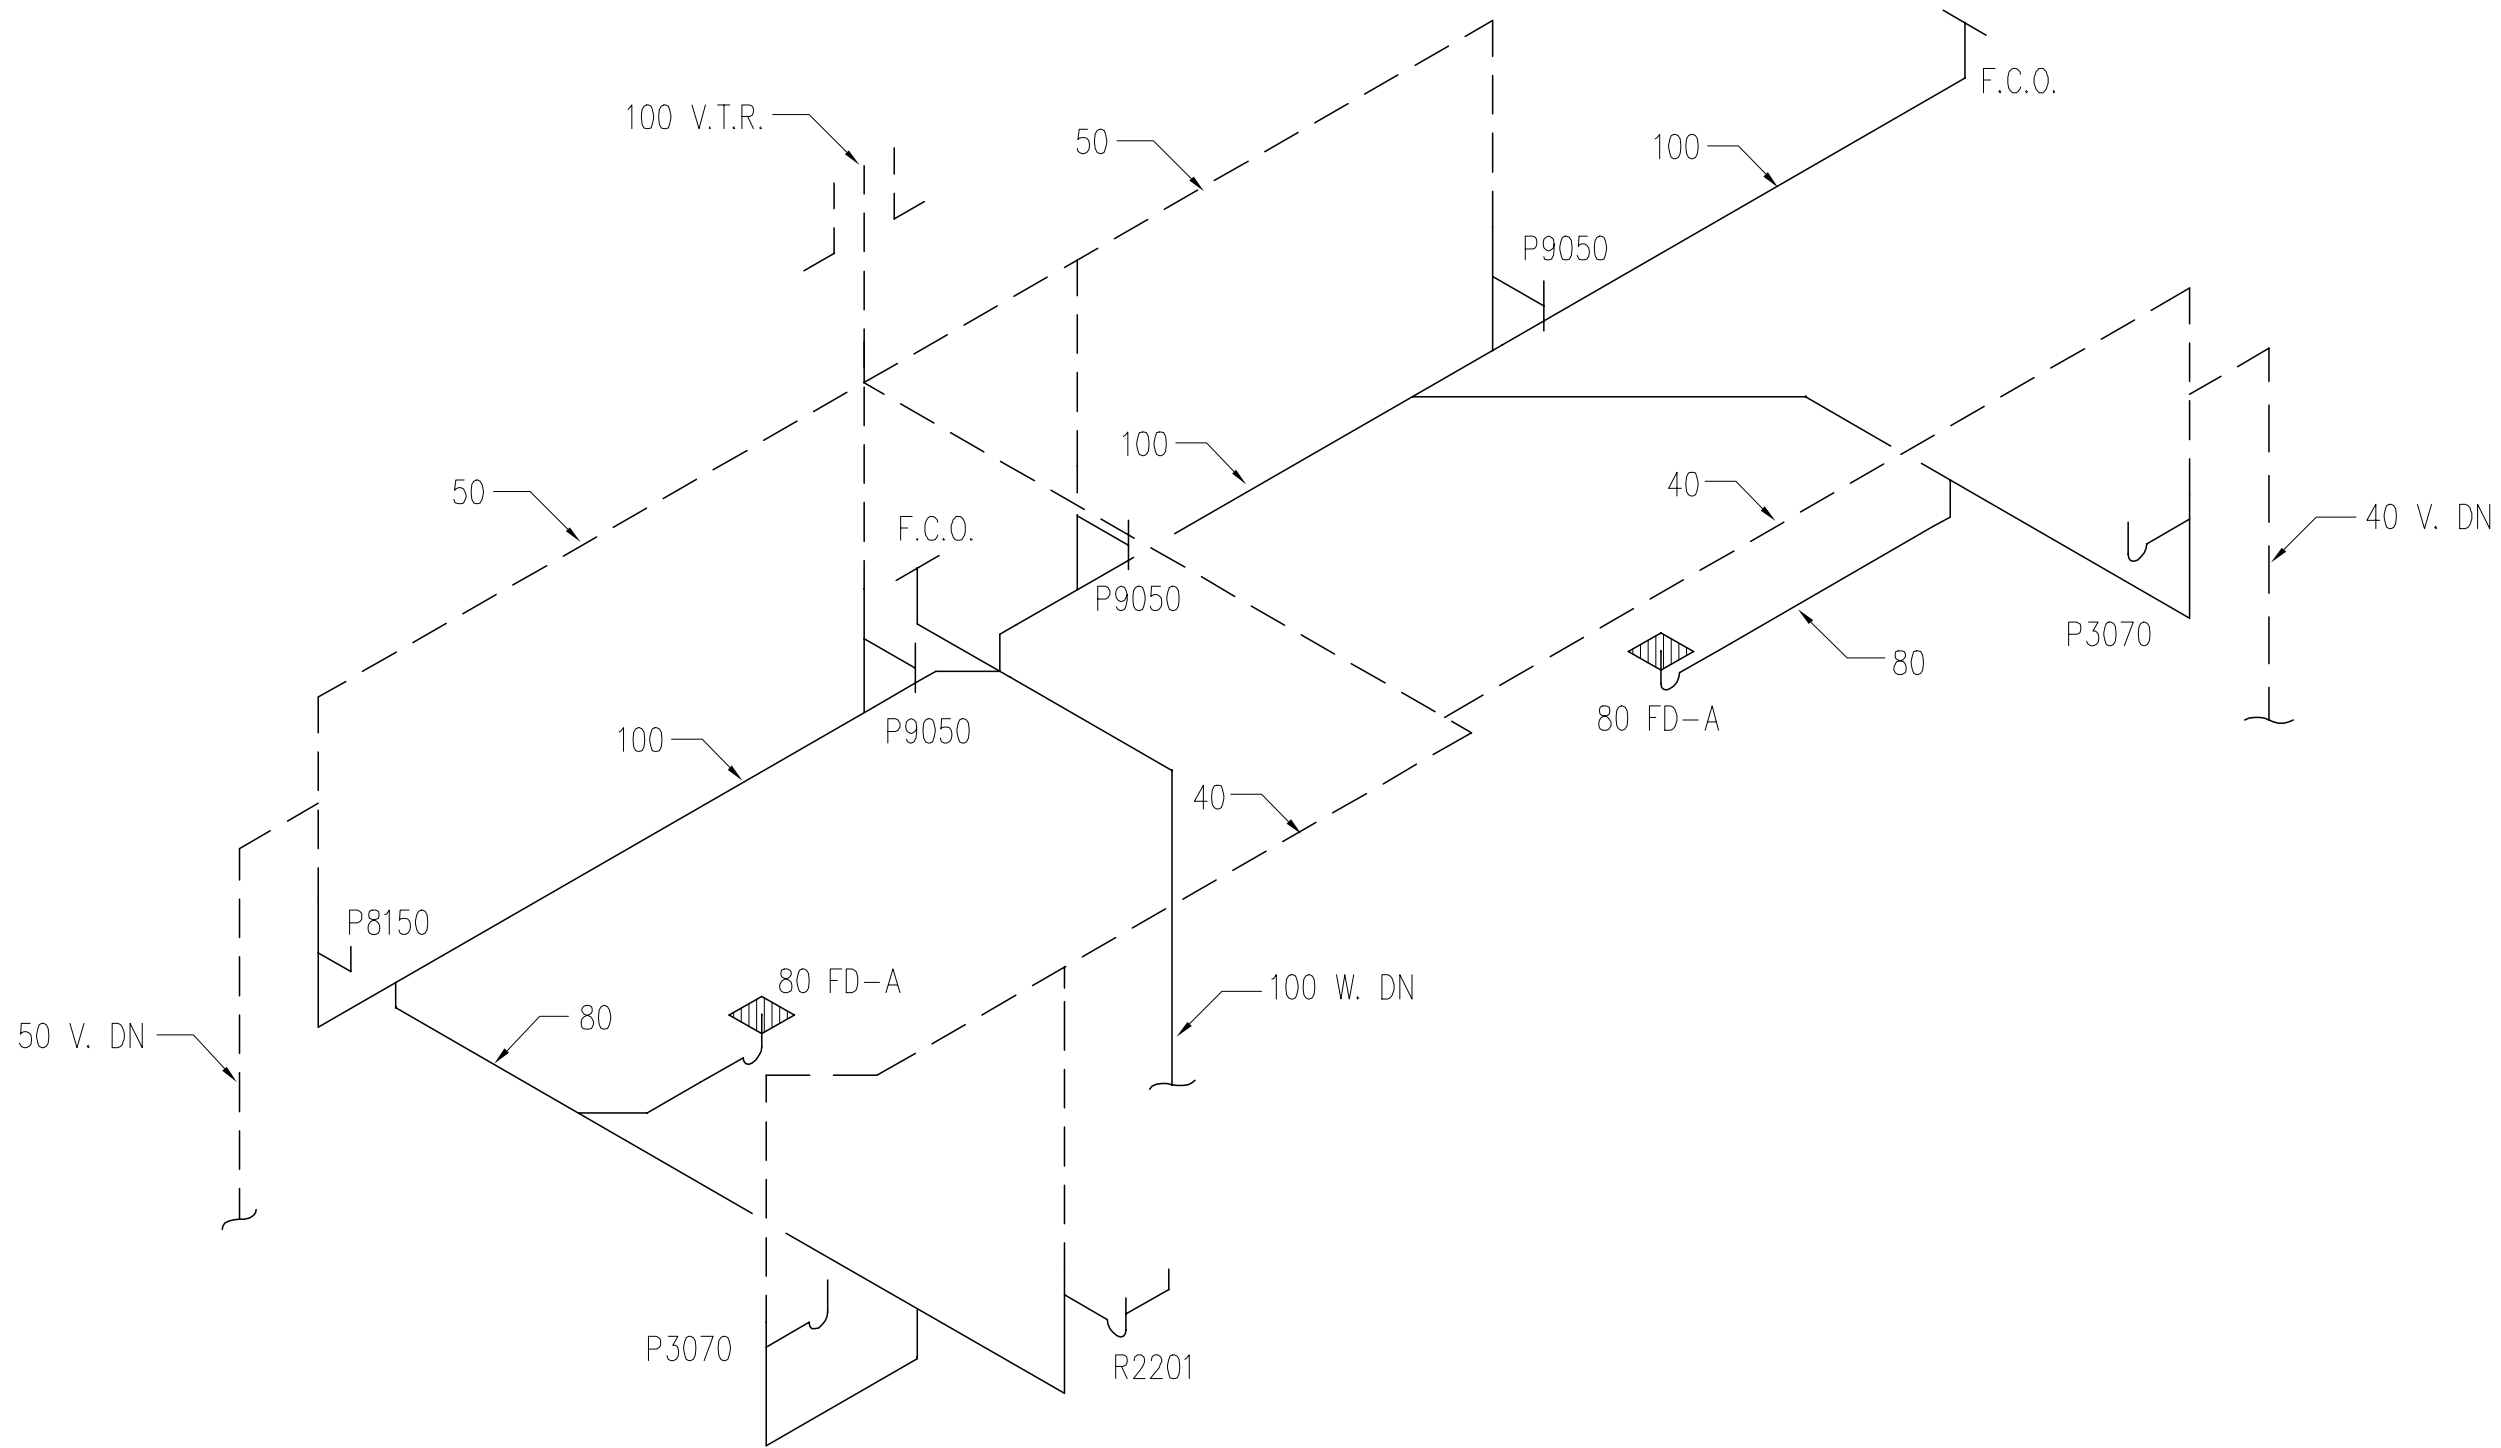


**WASTE RISER DIAGRAM  
FOR ROOM 2C23 AND 2C24**  
NOT TO SCALE

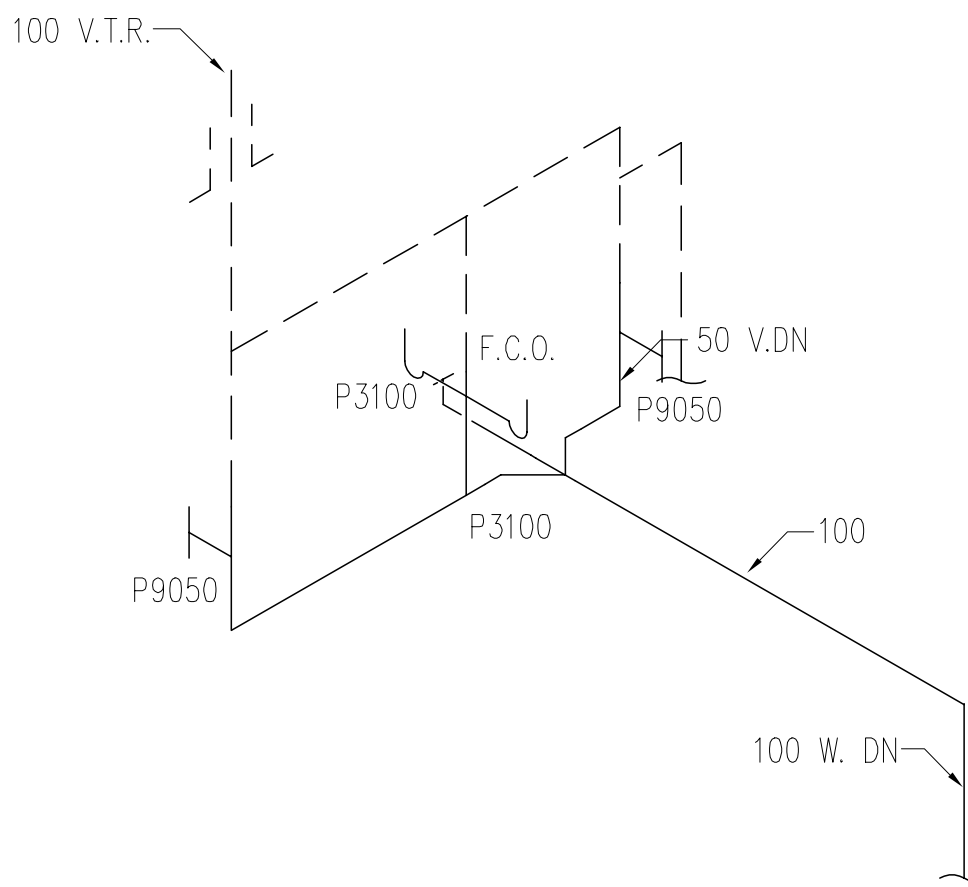


**WASTE RISER DIAGRAM  
FOR ROOM 2B05 AND 2B06**  
NOT TO SCALE

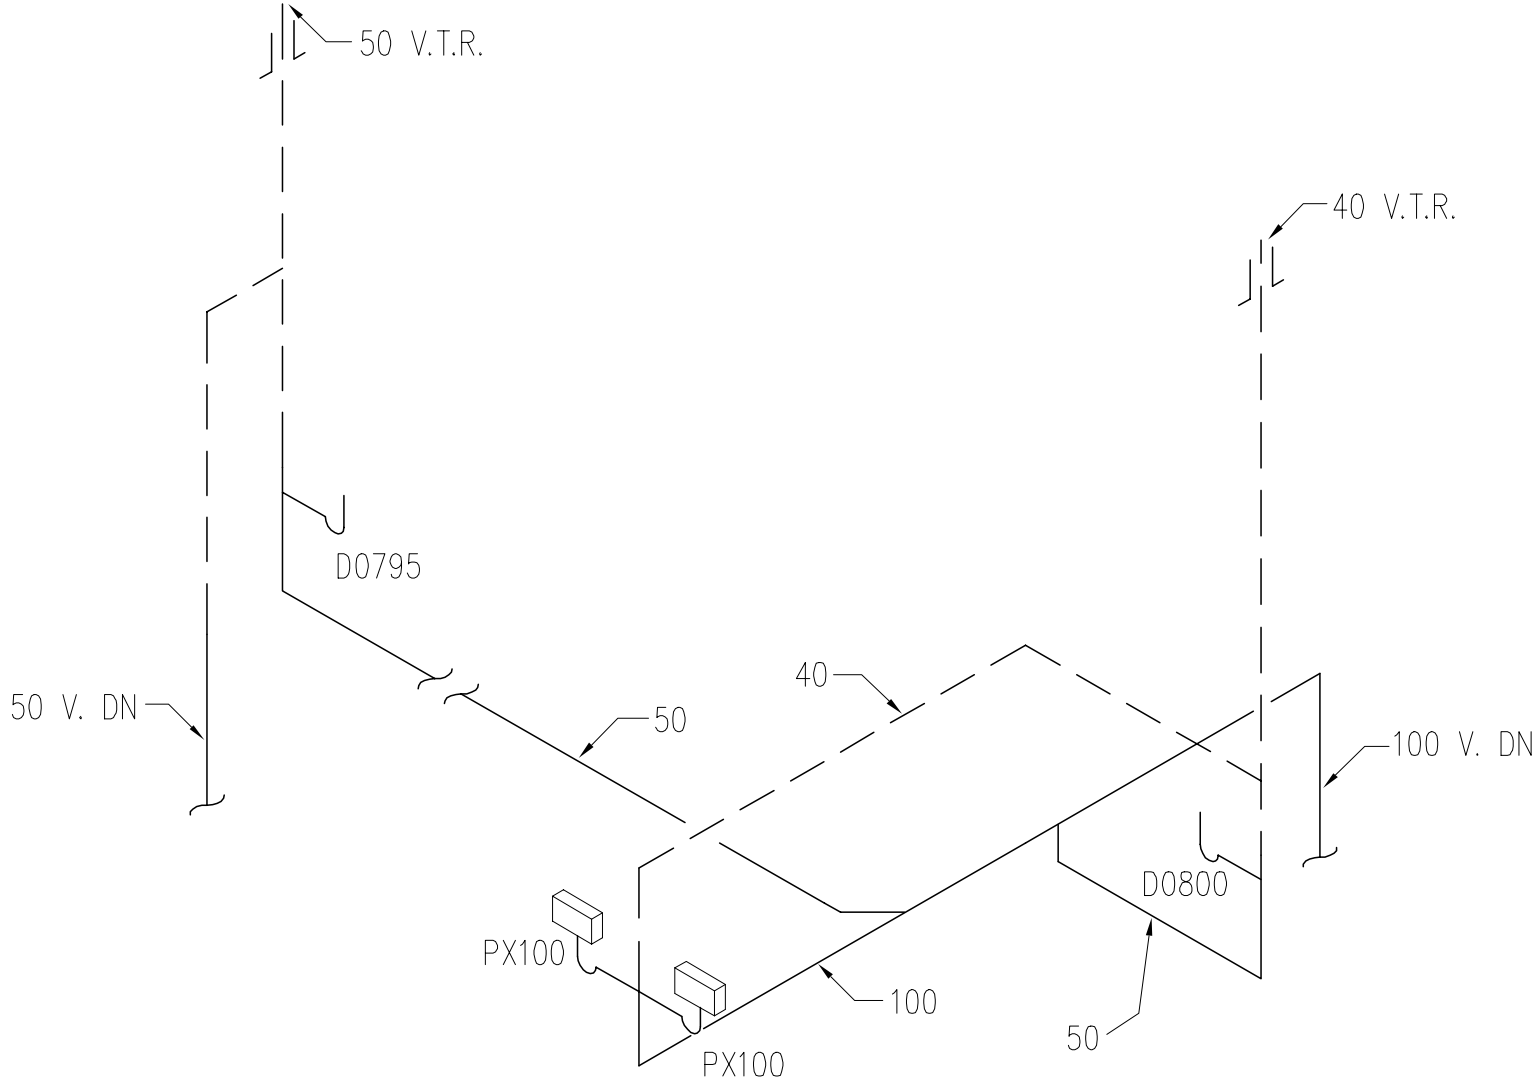


**WASTE RISER DIAGRAM  
FOR ROOM 2A13**  
NOT TO SCALE

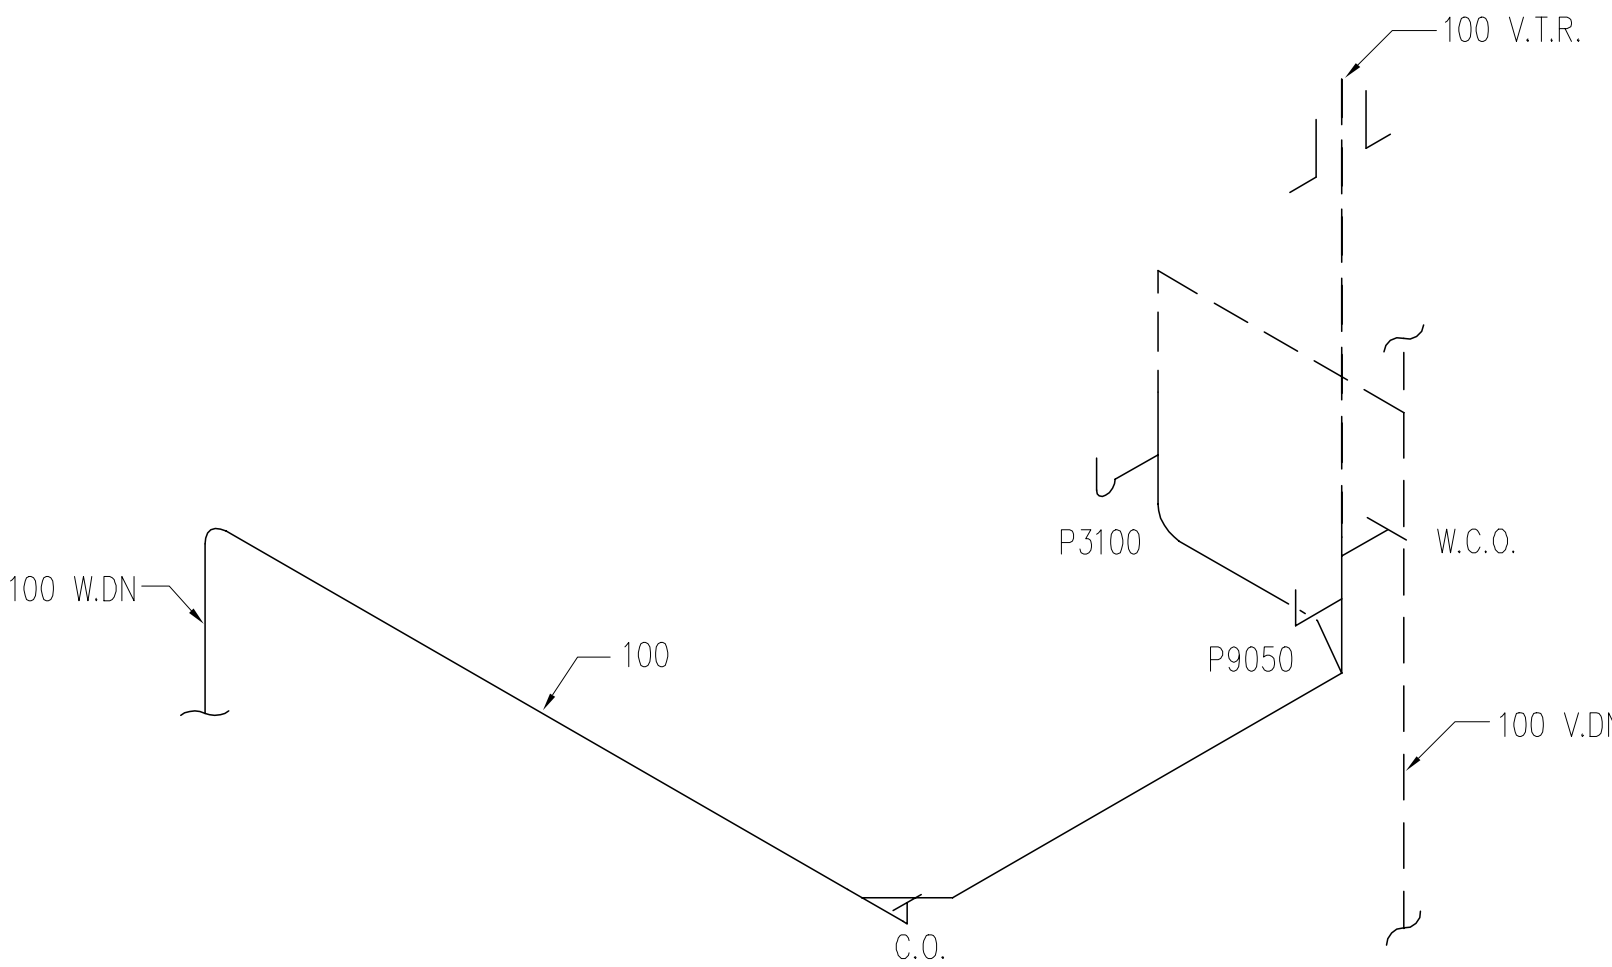


**WASTE RISER DIAGRAM  
FOR ROOM 2D12**  
NOT TO SCALE

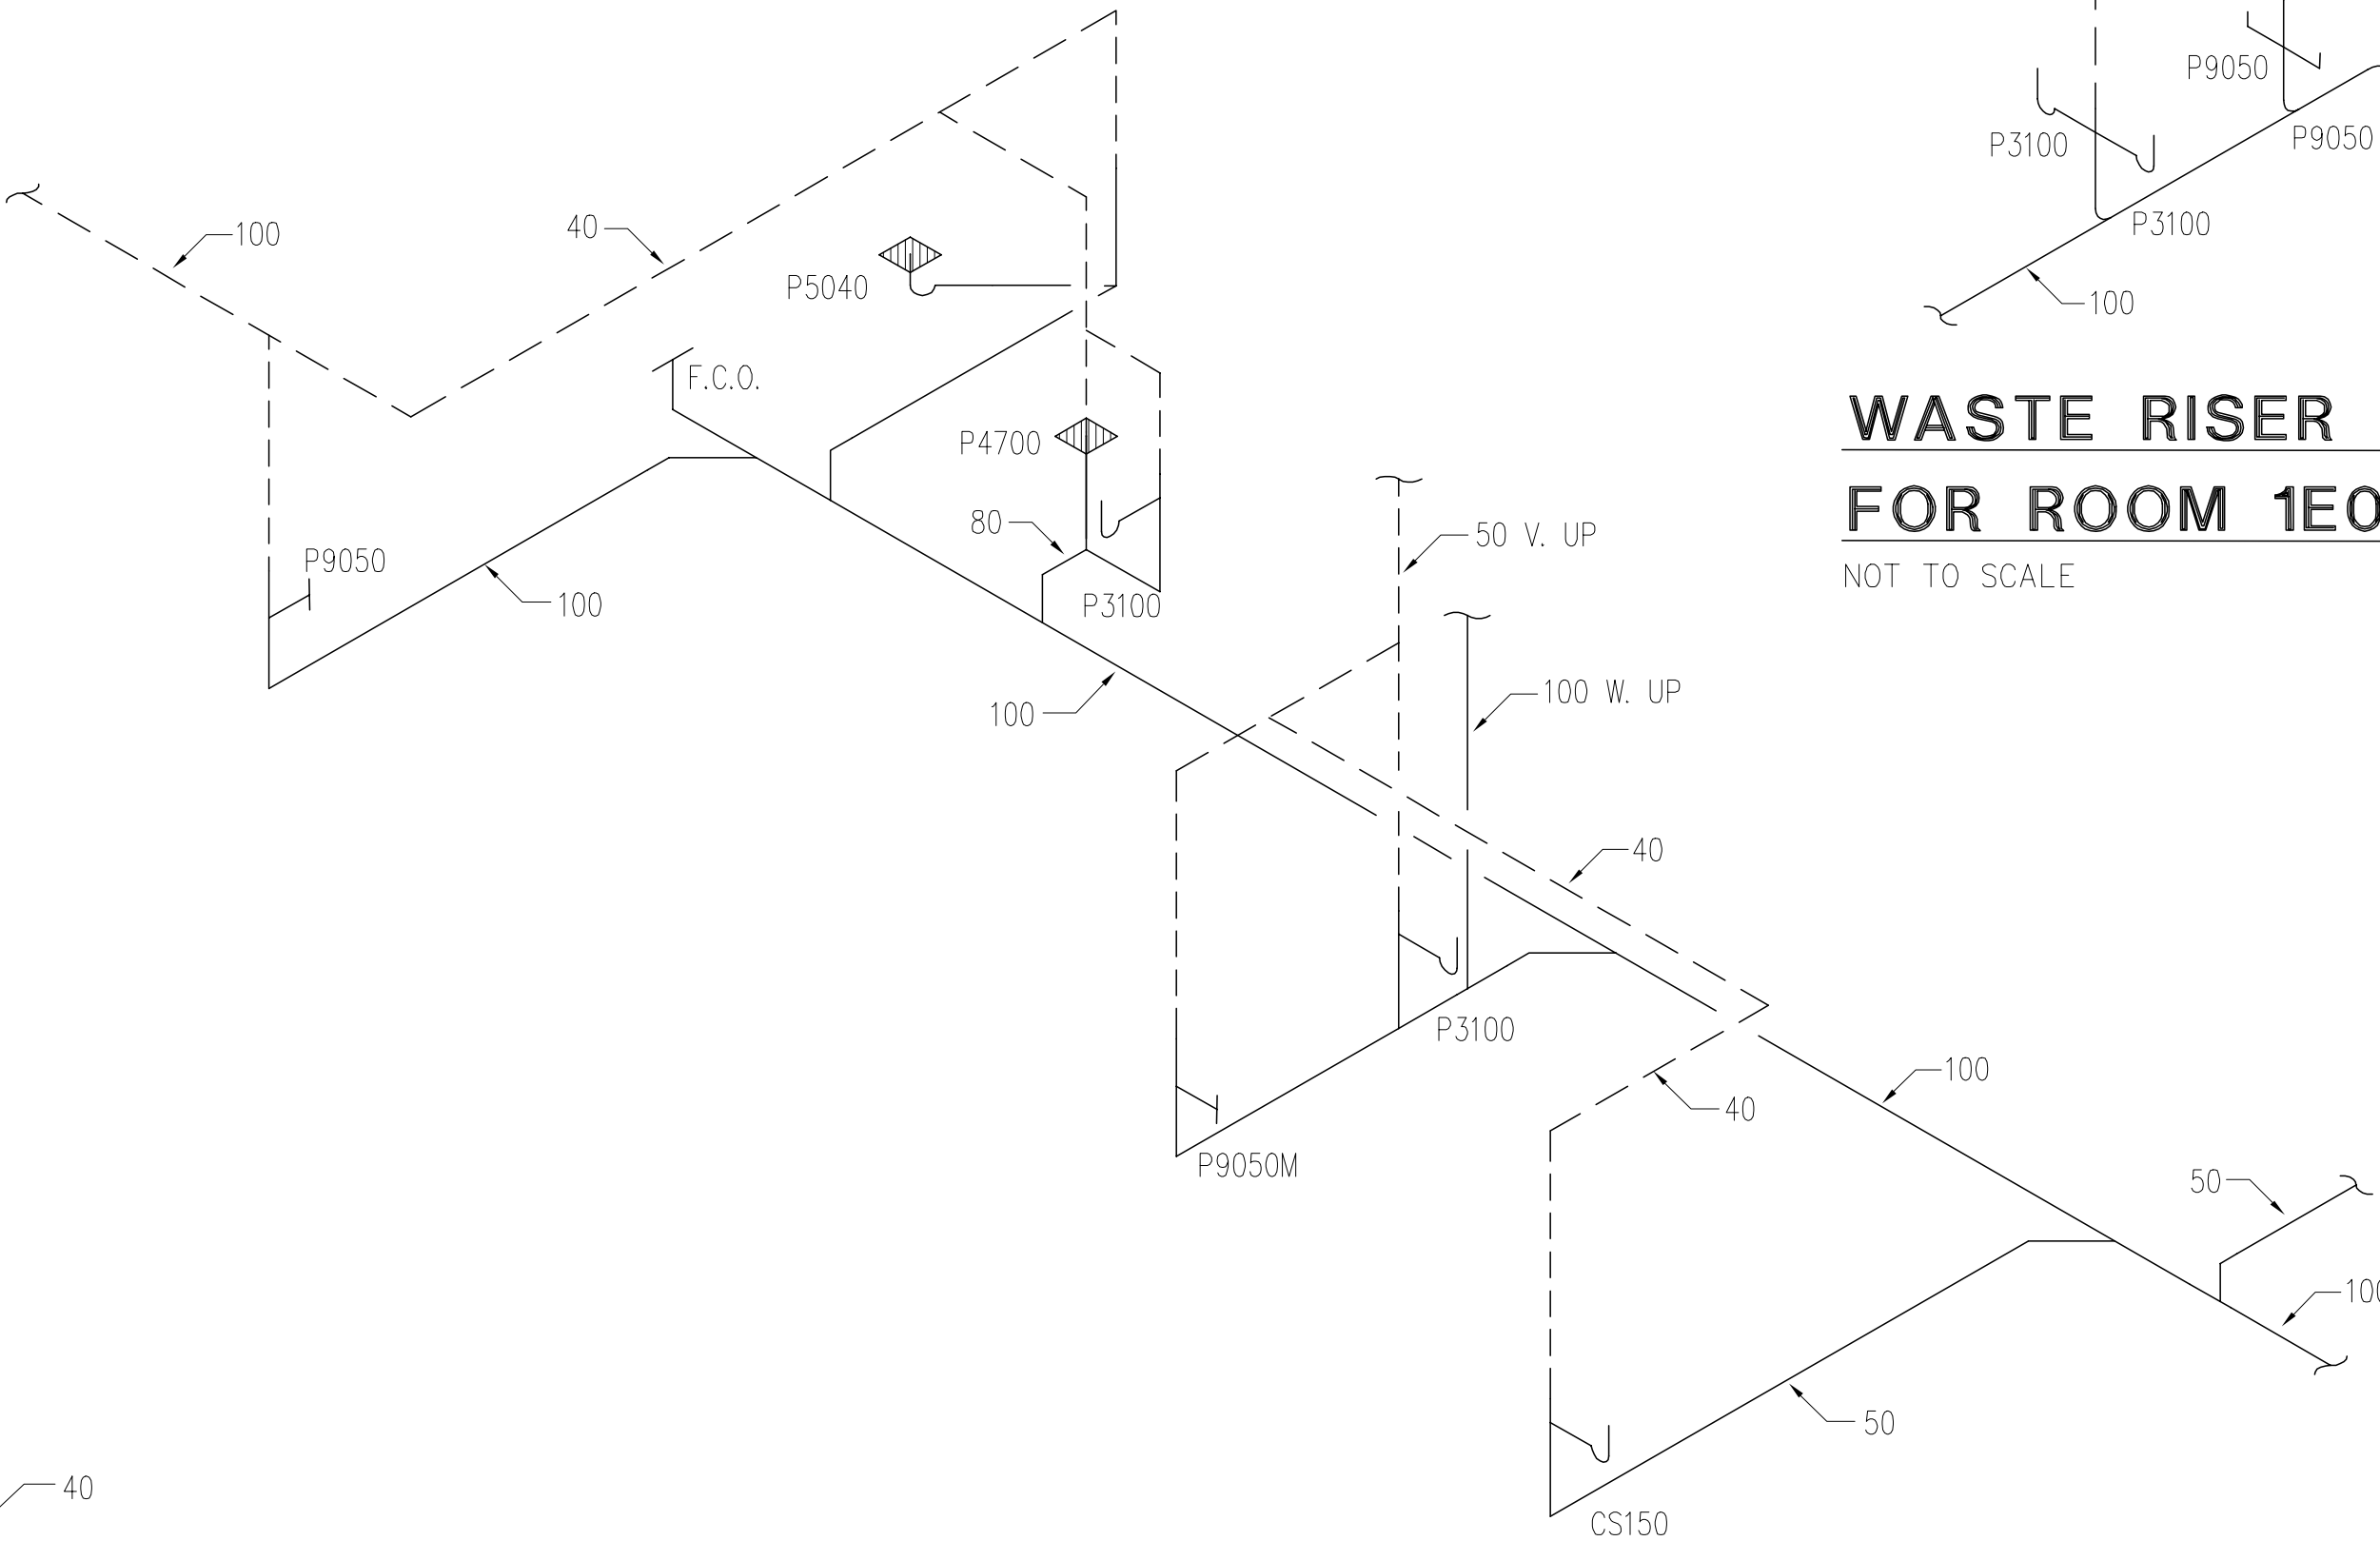


**WASTE RISER DIAGRAM  
FOR ROOM 1E09 AND 1E10**  
NOT TO SCALE

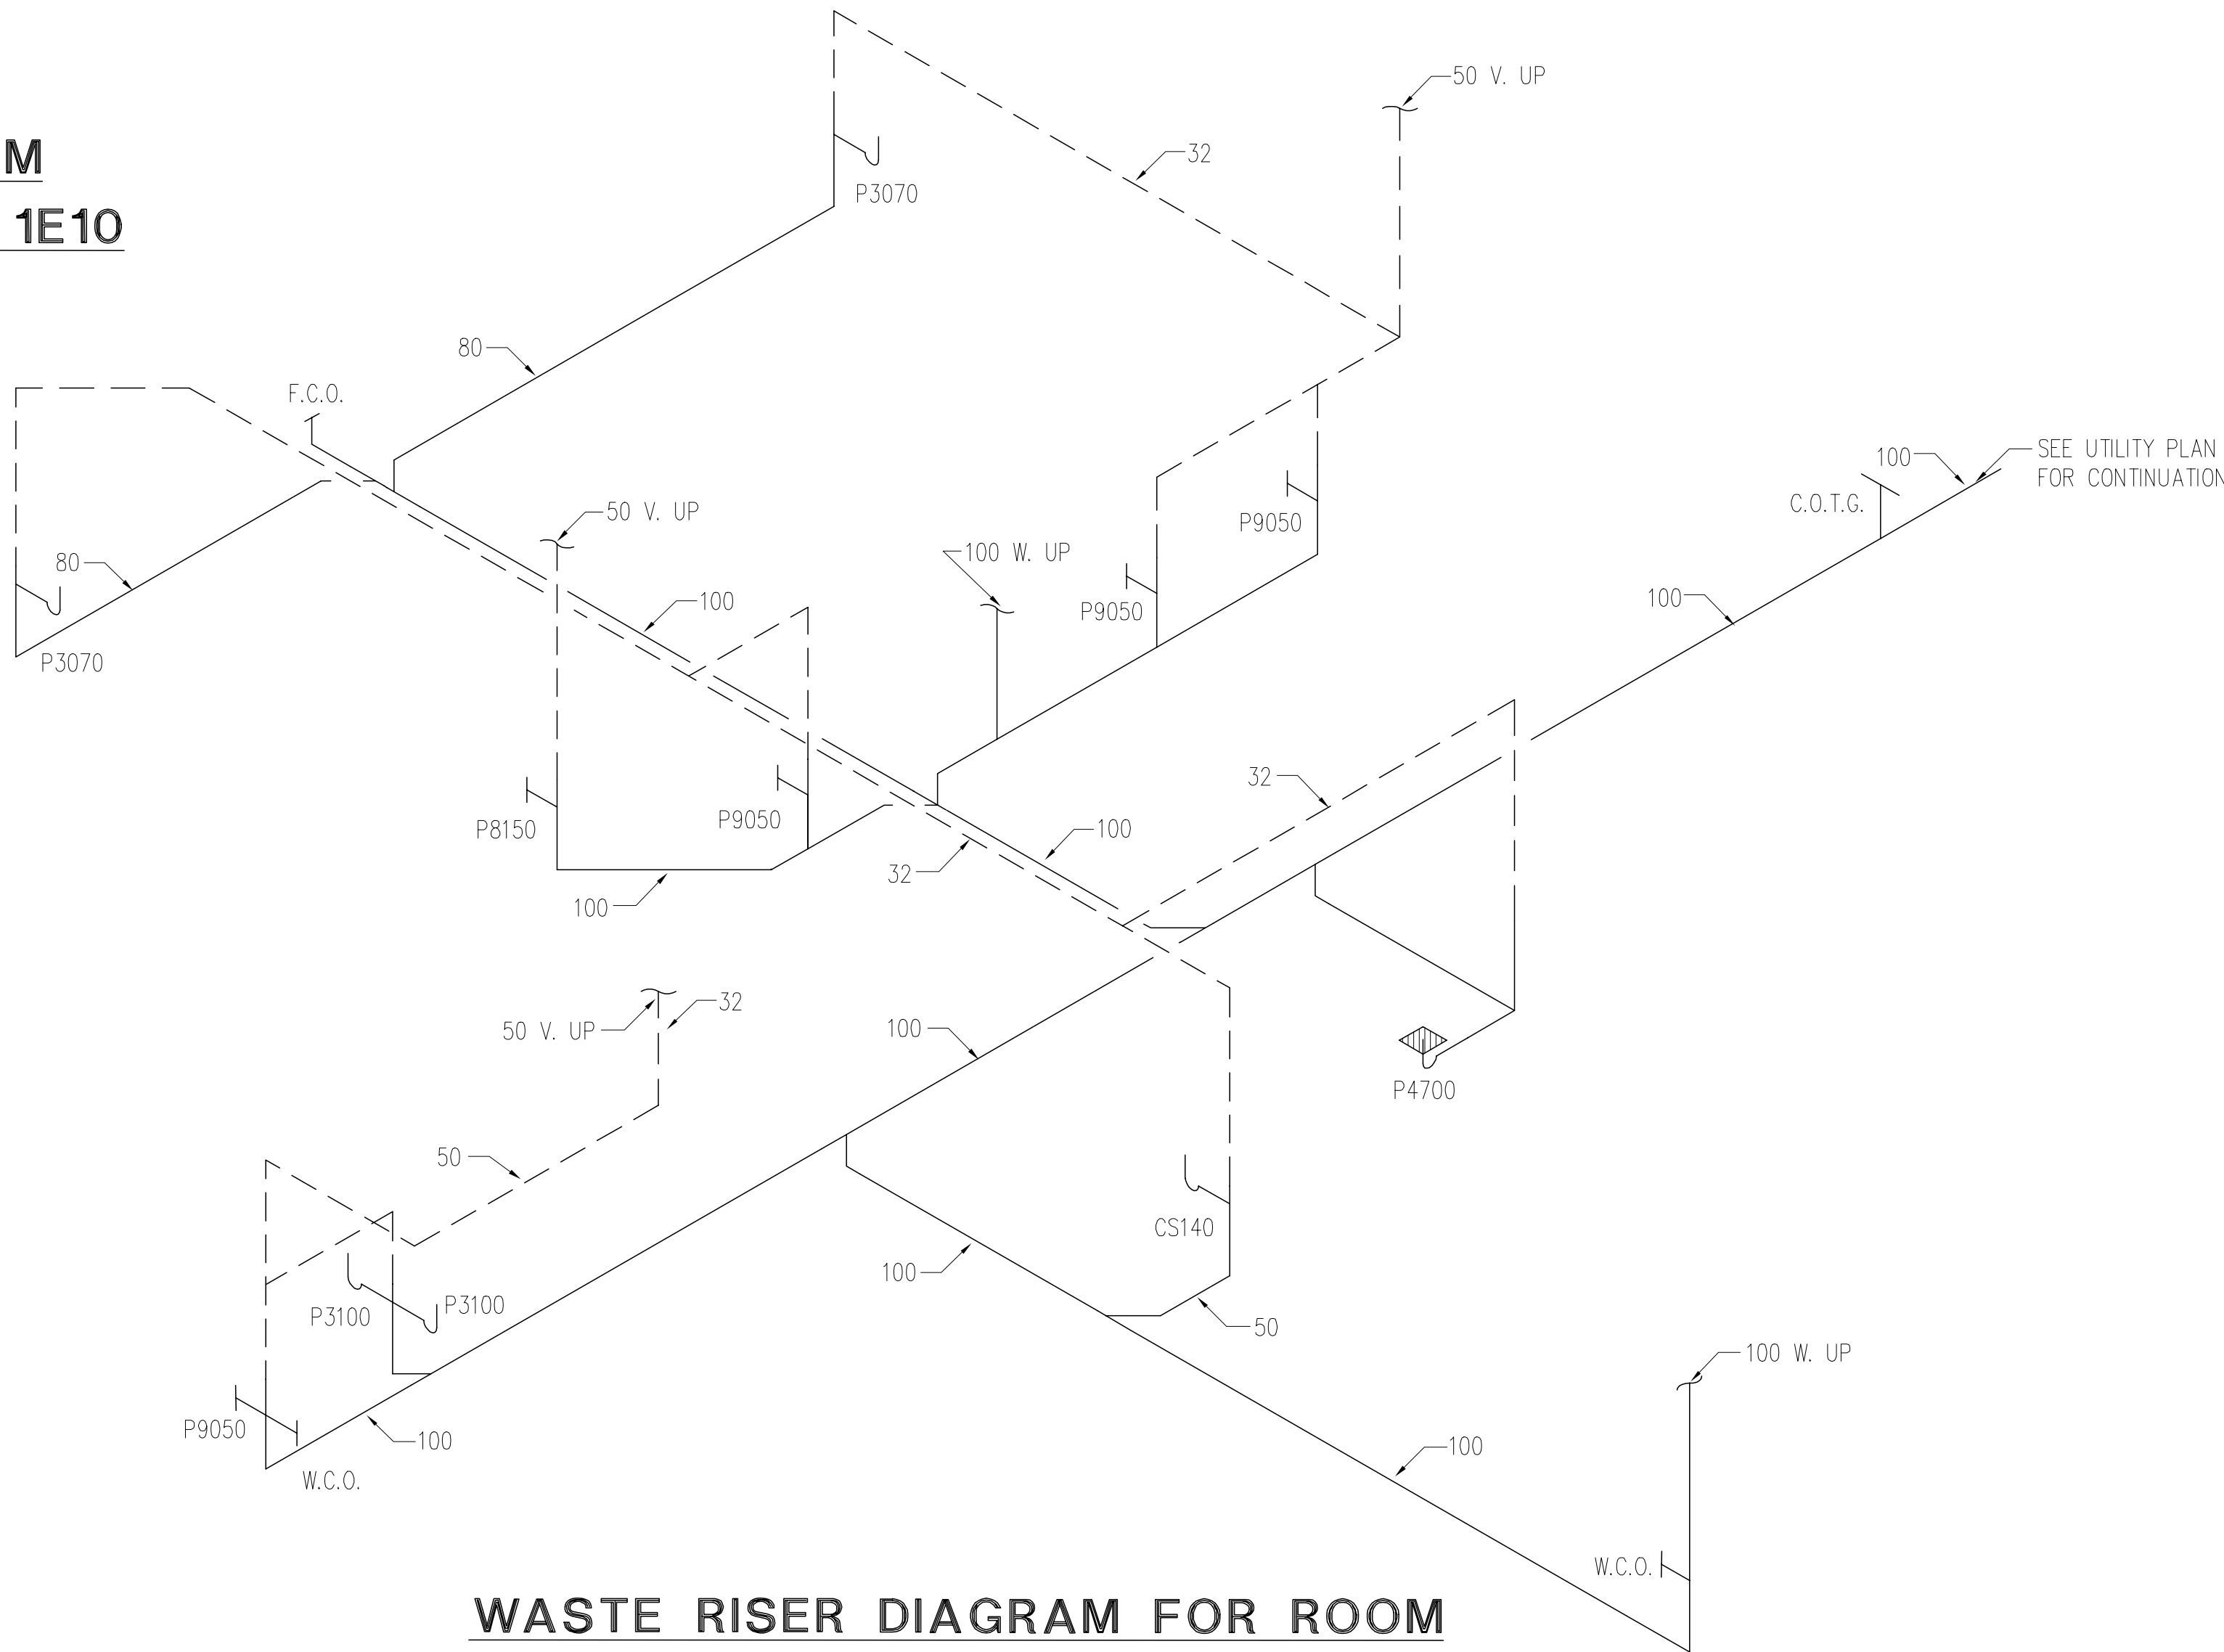

**WASTE RISER DIAGRAM FOR ROOM  
1A09, 1A10, 1A11, 1A12, AND 1A13**  
NOT TO SCALE

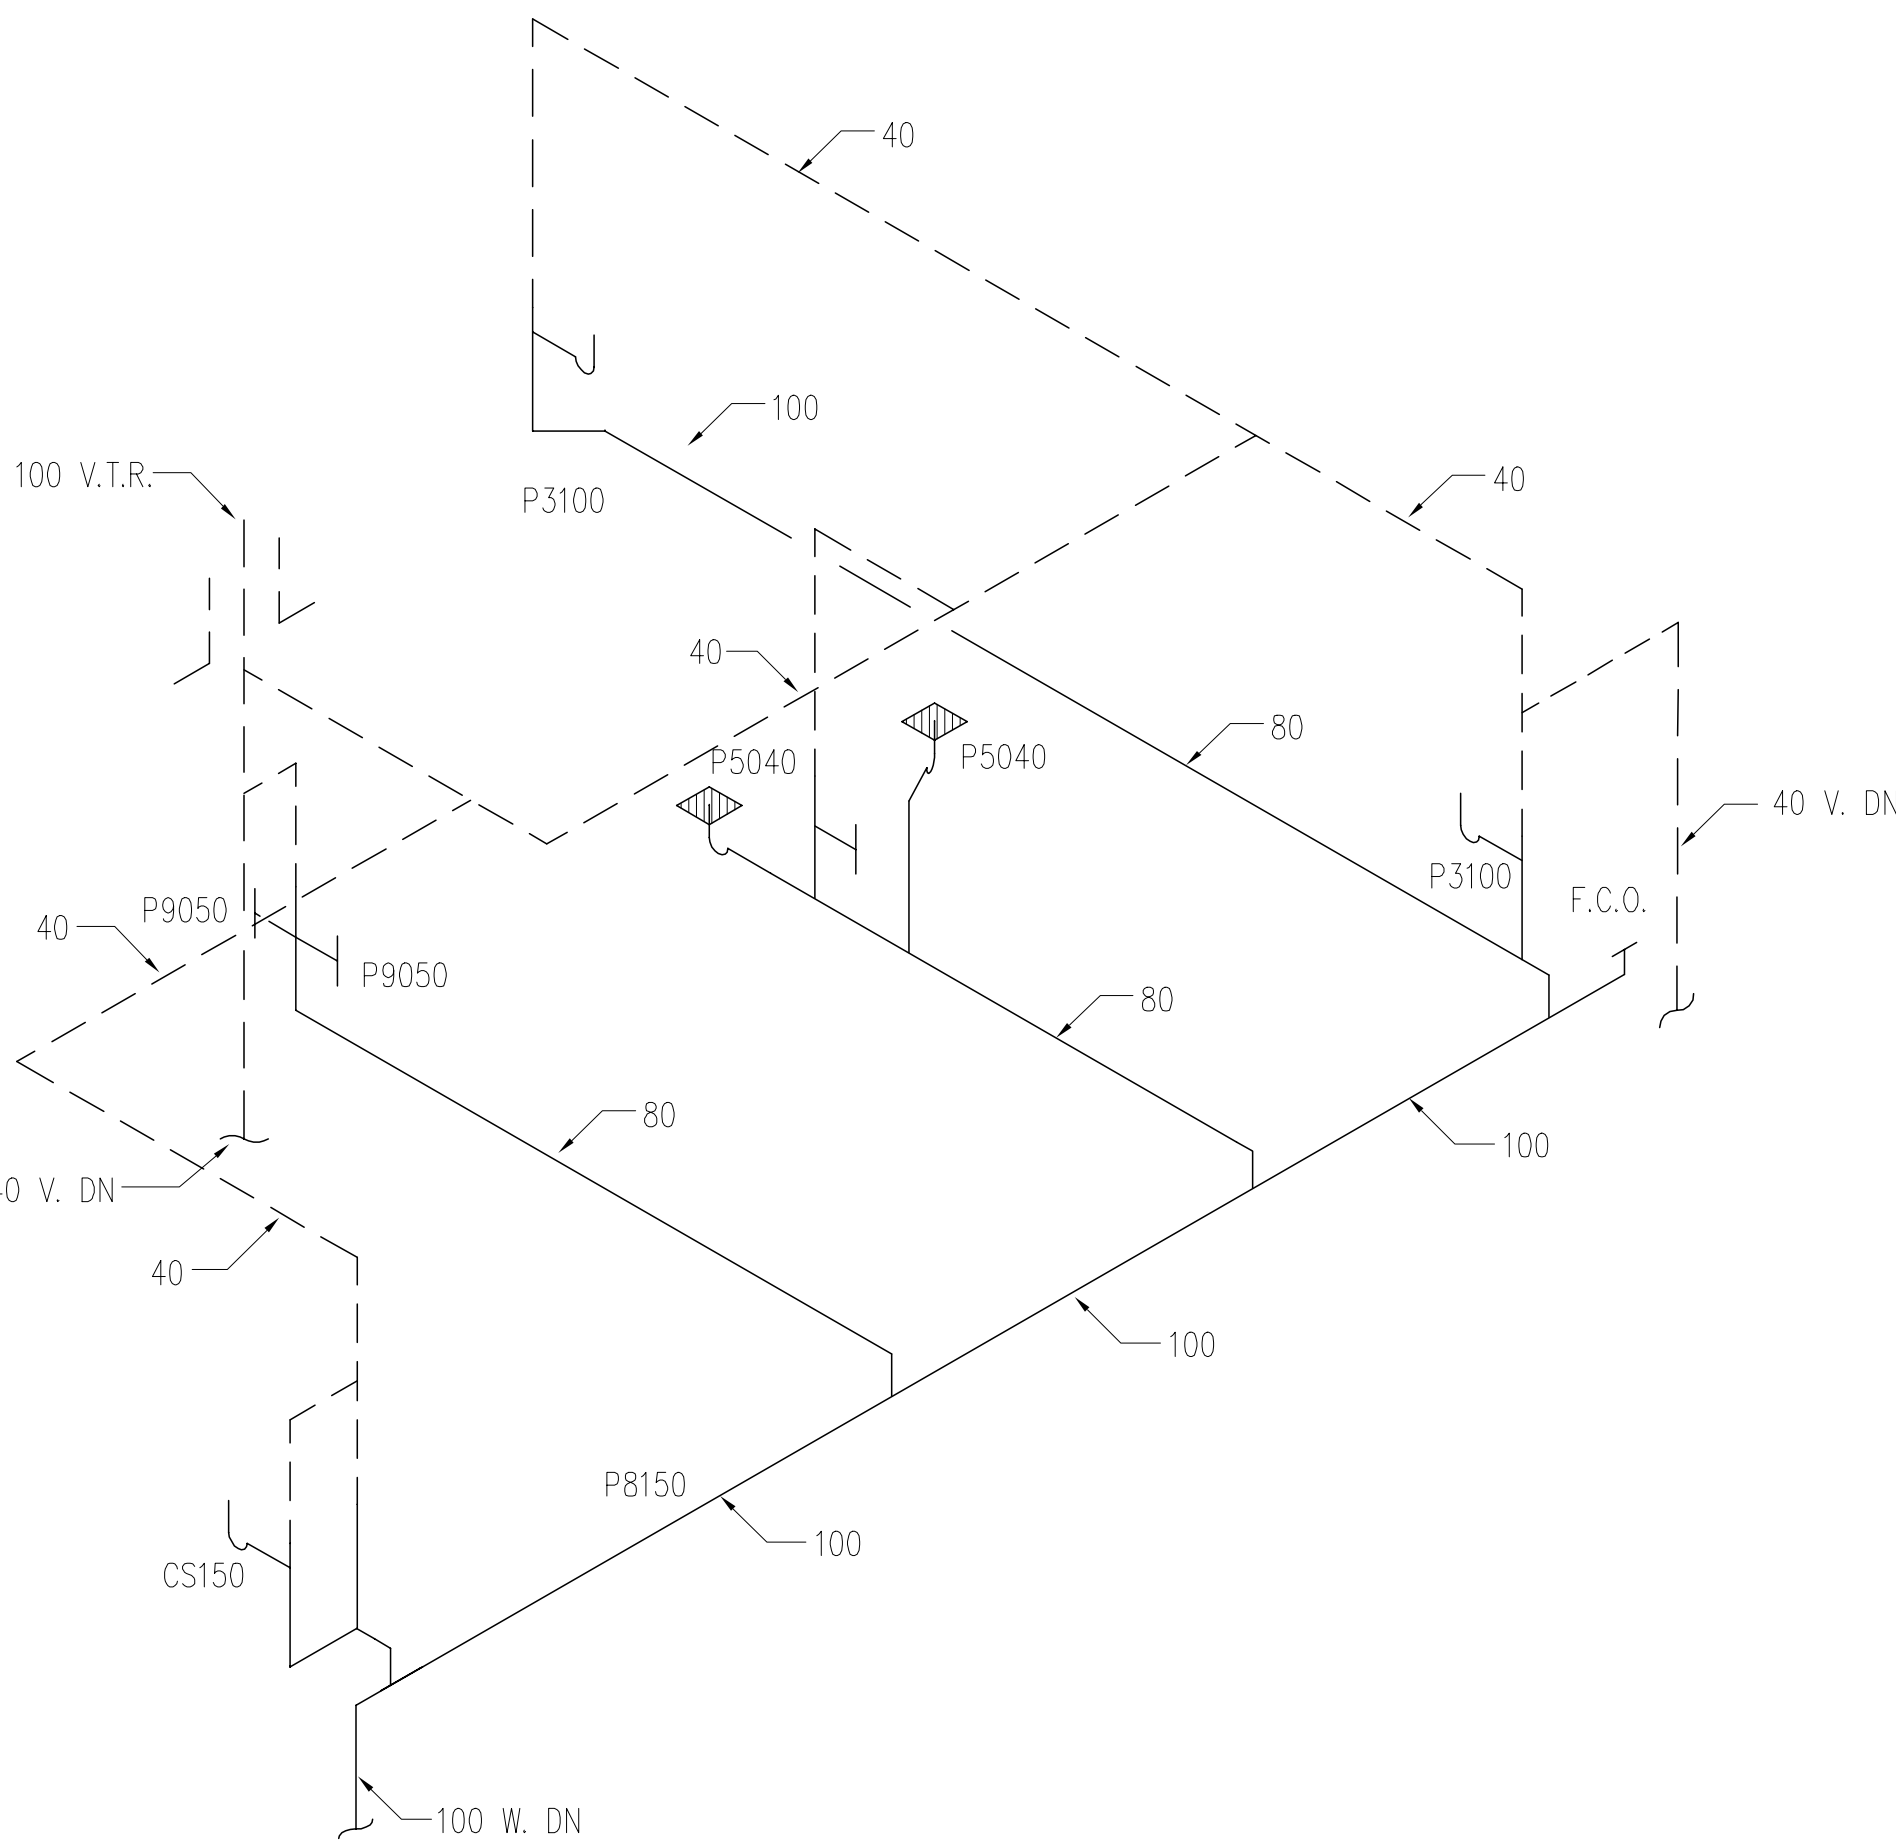

**WASTE RISER DIAGRAM  
FOR ROOM 2C07 AND 2C08**  
NOT TO SCALE

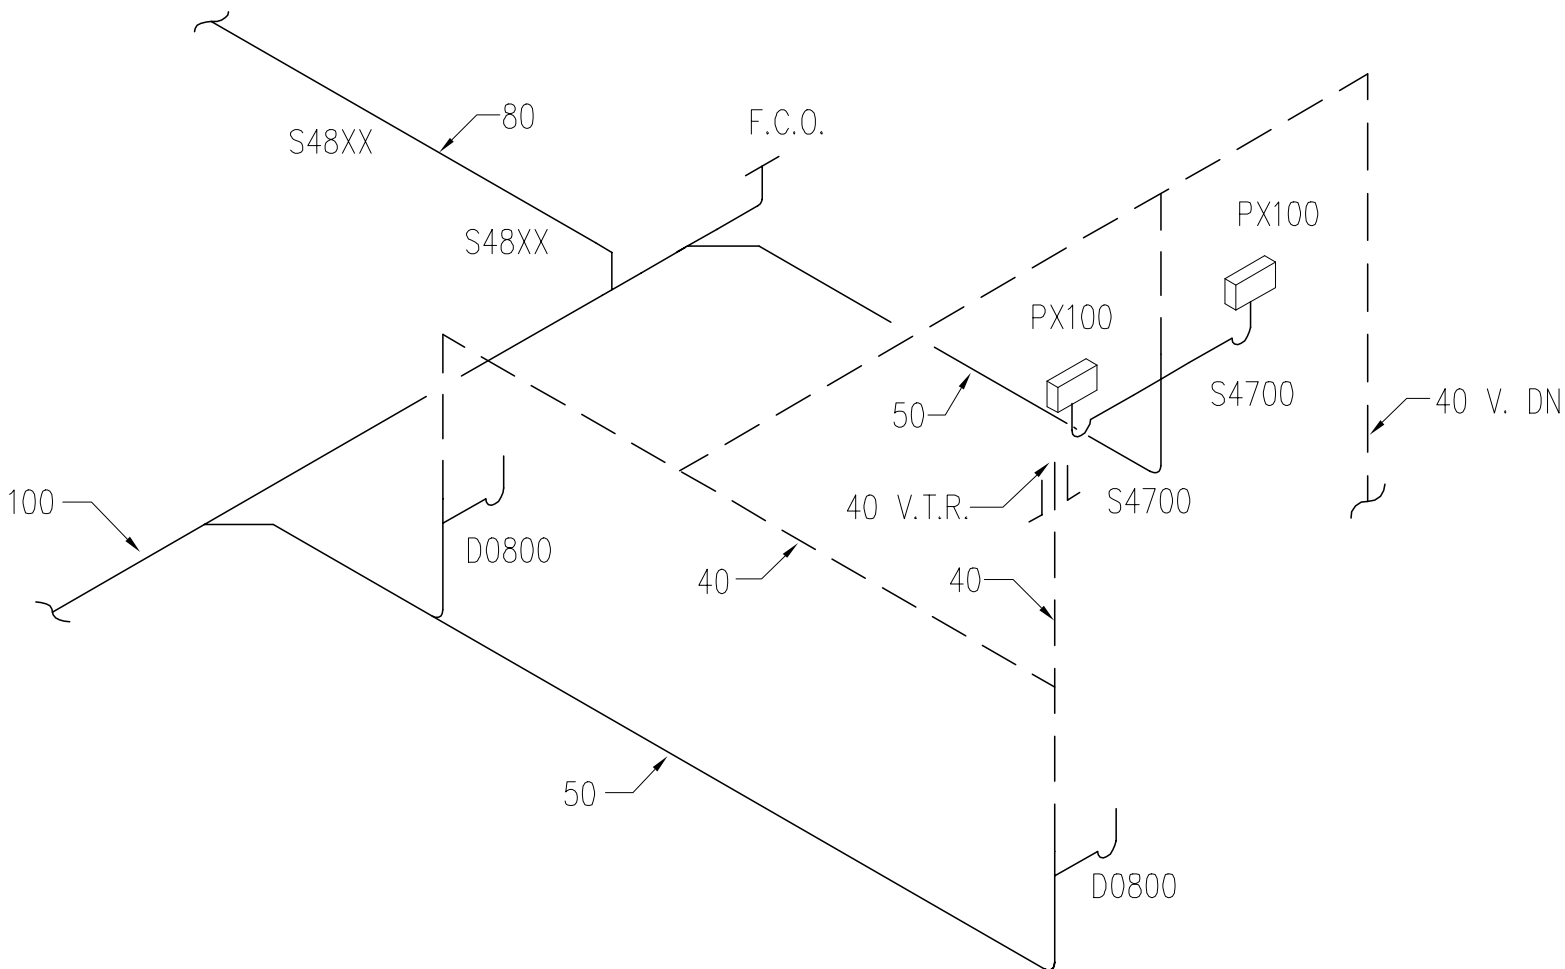

**WASTE RISER DIAGRAM  
FOR ROOM 2C10**  
NOT TO SCALE

IF SHEET IS LESS THAN 28"x42", IT IS A REDUCED PRINT. SCALE REDUCED ACCORDINGLY.

P5-1

| MEDICAL/DENTAL CLINIC  |                 |                   |  |  |
|------------------------|-----------------|-------------------|--|--|
| WASTE<br>RISER DIAGRAM |                 |                   |  |  |
| SIZE                   | CODE IDENT. NO. | DRAWING NO.       |  |  |
| F                      | XXXXX           | 8144708           |  |  |
|                        |                 | CONST. CONTR. NO. |  |  |
|                        |                 | SPEC. 11996048    |  |  |
|                        |                 | SHEET 203 OF 316  |  |  |